

NOTES:

- A. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
- B. APPLICABLE FOR 100mm DIAMETER DUCTS.
- C. DUCT ROLL NOT TO EXCEED ONE RADIAL POSITION OVER THE MINIMUM TRANSPOSITION LENGTH.

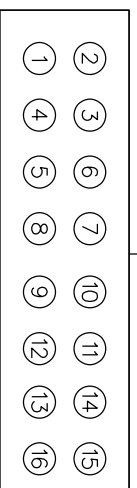



FIG. 1


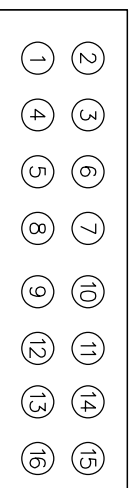



FIG. 2

TYPICAL MINIMUM TRANSPOSITION LENGTH FOR CHANGING FORMATION OF 100mm DIAMETER DUCTS:

FIG. 1 7500mm

FIG. 2 6000mm

REV.:	DATE:	PREP:	CHKD:	APPD:	TITLE	NO:	REV:	
CHANGE:	DATE: YYYY-MM-DD				 HydroOttawa www.hydroottawa.com	ENGINEERING SPECIFICATION DUCT TRANSPOSITION FROM 1H X 16W TO 4H X 4W	1 / 1 OF 0	
CHANGE:	DATE: YYYY-MM-DD			PREP: M. MALONEY CHKD: C. PROULX				CONSTRUCTION DETAIL UDS0035
CHANGE:	DATE: YYYY-MM-DD			APPD: C. MALONE P.Eng. DATE: 2015-06-26 SCALE: N.T.S. @ ANSIA				

Hydro Ottawa Use Only Copyright © 2015