


1-3 SERVICES

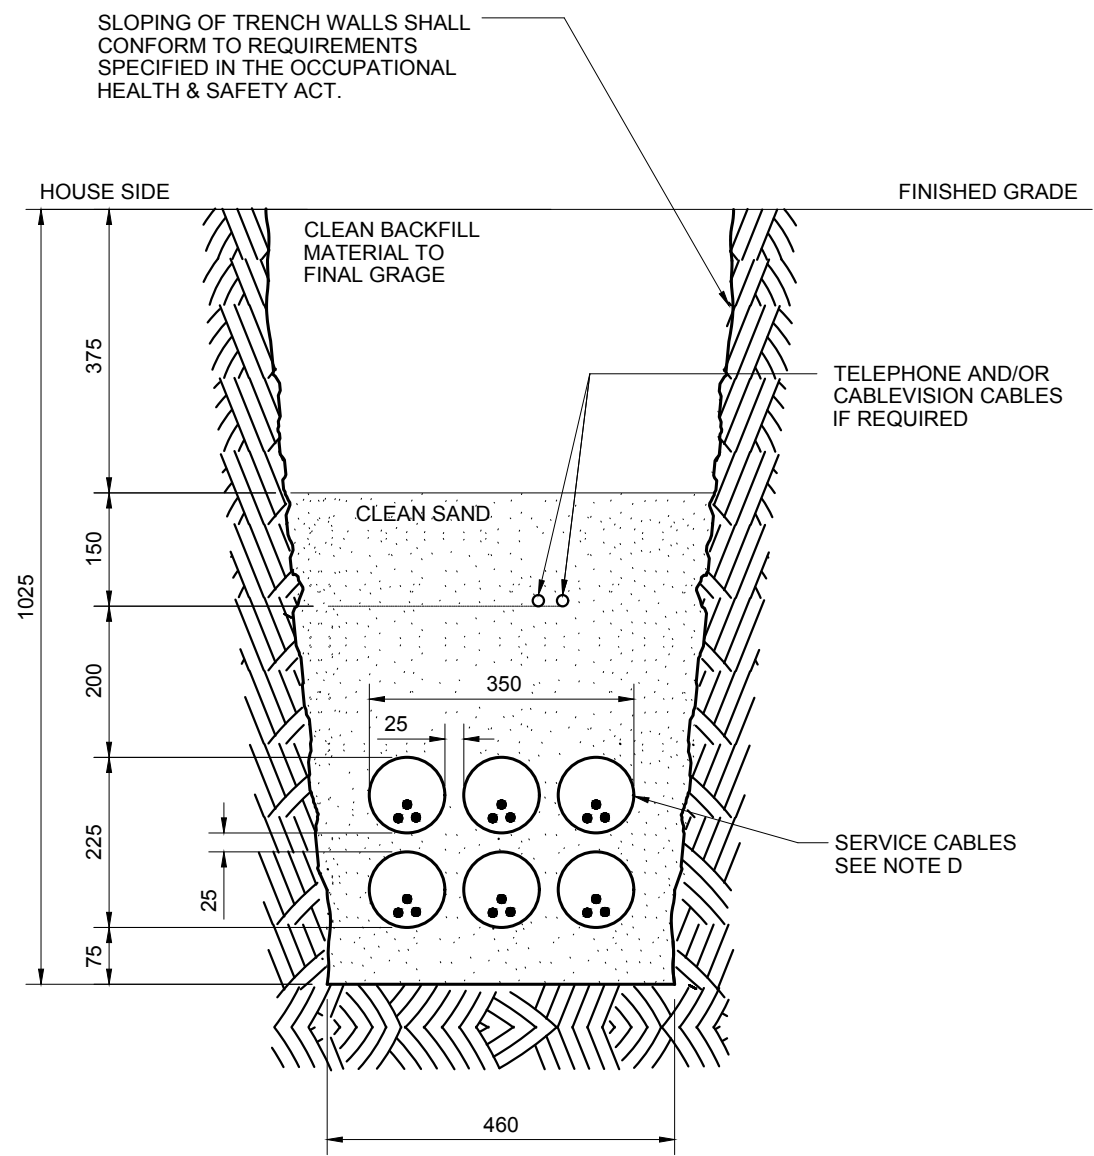

4-6 SERVICES

NOTES:

- A. DUCT TO BE JOINED AT THE PROPERTY LINE TO PROVIDE A CONTINUOUS CONDUIT FROM THE SUPPLY POINT TO 1000mm FROM THE METER BASE.
- B. SPLICE PITS A (MINIMUM DIMENSION OF 1200mm x 1200mm) SHALL BE COMPLETELY BACKFILLED WITH CLEAN SAND.
- C. TRENCH AND BACKFILL MATERIAL TO BE INSPECTED BY HYDRO OTTAWA PRIOR TO BACKFILLING
- D. INSTALL UNDERGROUND CABLE IN 100mm (4") DB2 DUCT TO WITHIN 1200mm (4') OF METER BASE WHEN ADJACENT TO OR UNDER SURFACES SUCH AS DRIVEWAYS, SIDEWALKS, LARGE OBSTALES (SUCH AS TREES, HEDGES, OR DECORATIVE STONE), ESTATE OR INFILL TYPE LOTS OR FOR LENGTHS OF CABLE >30M ON PRIVATE PROPERTY. A 9.65mm [3/8"] ROPE SHALL BE INSTALLED IN THE DUCT.
- E. ALL MEASUREMENTS IN MILLIMETERS UNLESS OTHERWISE NOTED.
- F. ALL BACKFILL MATERIAL MUST BE APPROVED BY HYDRO OTTAWA INSPECTOR: FOR ACCEPTABLE BACKFILL MATERIAL, SEE HYDRO OTTAWA SPECIFICATION DOCUMENT GCS0001 APPENDIX "A".
- G. MINIMUM OFFSET FROM DUCT TO CENTERLINE TO FOUNDATION IS 100mm.

| REVISIONS | | | PREP | CHKD | APPD | TITLE | |
|-----------------|-------|--|------|------|------|-------------------------|--|
| REV: CHANGE: | DATE: | | | | | www.hydroottawa.com | ENGINEERING SPECIFICATION |
| REV: CHANGE: | DATE: | | | | | | THREE-PARTY SERVICE TRENCH WITH MULTIPLE SERVICES |
| REV: CHANGE: | DATE: | | | | | | CONSTRUCTION DETAIL |
| REV: CHANGE: | DATE: | | | | | | NO: UDS0043 |
| | | | | | | SCALE: N.T.S. @ ANSI B | 1 OF 1 |
| | | | | | | | REV: 0 |

LAST SAVED: 2018-06-29 10:40 AM