

NOTES:

A. SEE HYDRO OTTAWA PRIMARY VOLTAGE SERVICE SPECIFICATION GCS0002.


B. A CUSTOMER OWNED AND OPERATED ISOLATION SWITCH COMPLETE WITH PROTECTION MAY BE REQUIRED FOR HYDRO OTTAWA OWNED AND OPERATED LOOP FEEDERS IN CUSTOMER OWNED SWITCHBOARD.

C. MAXIMUM 13.2kV LOOP SUPPLY IS 8.2 MVA BASED ON SUPPLY CABLE OF 3 x 500MCM CU.

A BUS

TIE-SWITCH

B BUS

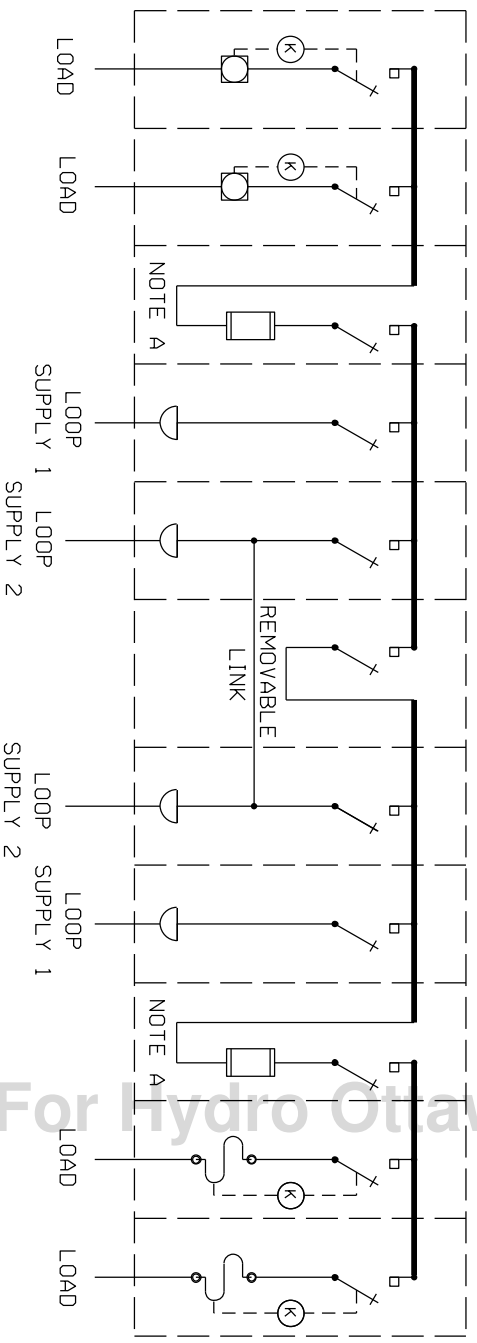

REVISONS	PREP	CHKD	APPD	TITLE
REV: 1 CHANGE: NOTES A & B ADDED	GM	CP	CSM	<p>HydroOttawa www.hydro-ottawa.com</p> <p>ENGINEERING SPECIFICATION SWITCHING ARRANGEMENT FOR INDOOR METALCLAD 13.2kV LOOP SYSTEM (ABOVE 7000kVA) SINGLE LINE</p>
REV: 2 CHANGE: TITLE CHANGE ADDED NOTE 'C'	WS	RW	CSM	
REV: CHANGE: DATE: YYYY-MM-DD				
<p>PREP: G. MAGILL CHKD: G. MAGILL APPD: C. MALONE DATE: 2002-04-03 SCALE: N.T.S. @ ANSI A</p>				NO:
<p>ECS0004</p>				<p>1 OF 1 REV: 2</p>

TIME \$

DATE \$

FILE \$