



NOTES:



- A. ALL DIMENSIONS ARE IN MILLIMETRES, UNLESS OTHERWISE SPECIFIED.
- B. GUYING, IF REQUIRED BY ESA OR OESC.
- C. MINIMUM LENGTH OF RW90 CONDUCTOR, LEFT AT SERVICE HEAD SHALL BE AT LEAST 750 [30"].
- D. SECONDARY SPOOL AND RACK SUPPLIED AND INSTALLED BY CUSTOMER.
- E. PVC AND EMT CLAMPS AND EXPANSION COUPLES AS PER ESA AND OESC.
- F. 4-JAW KING-SIZED METERBASE. REFER TO HYDRO OTTAWA SPECIFICATIONS GCS0008, TABLE 1, MCS0008 FOR MORE INFORMATION.
- G. SERVICE MAST INSTALLATION IN ACCORDANCE WITH ESA AND OESC.
- H. REFER TO MCS0105 & MCS0106 FOR MINIMUM CLEARANCE REQUIREMENTS IN FRONT OF METER TO CUSTOMER PROPERTY LINE AND/OR NEXT TO METER EQUIPMENT.
- I. CONTACT HYDRO OTTAWA PRIOR TO INSTALLATION TO OBTAIN SERVICE LAYOUT.
- J. INSTALLATION SUBJECT TO ESA REQUIREMENTS AND INSPECTION.
- K. MINIMUM AND MAXIMUM CLEARANCES AS PER ESA AND OESC. PER IHSA SAFE PRACTICE GUIDE, VOLUME ONE, SECTION 7: LADDER SAFETY. LADDER SETUP SHALL NOT EXCEED A RATIO OF 4:1 FOR HEIGHT ON STRUCTURE TO AN UNOBSTRUCTED, AT GRADE, DISTANCE FROM THE STRUCTURE WITHIN THE SAME PROPERTY.

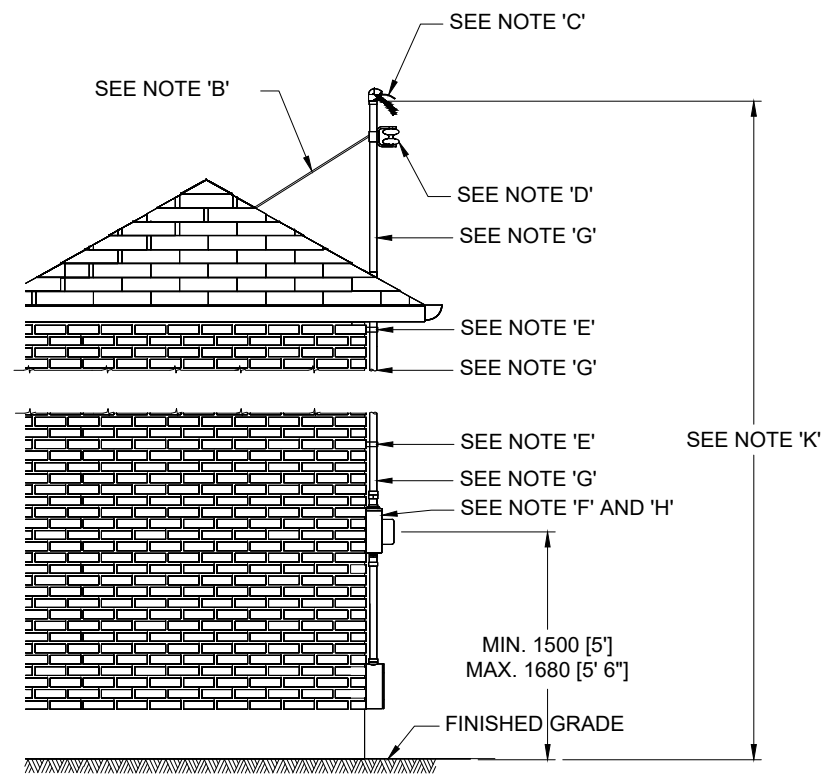


RESIDENTIAL BUNGALOW

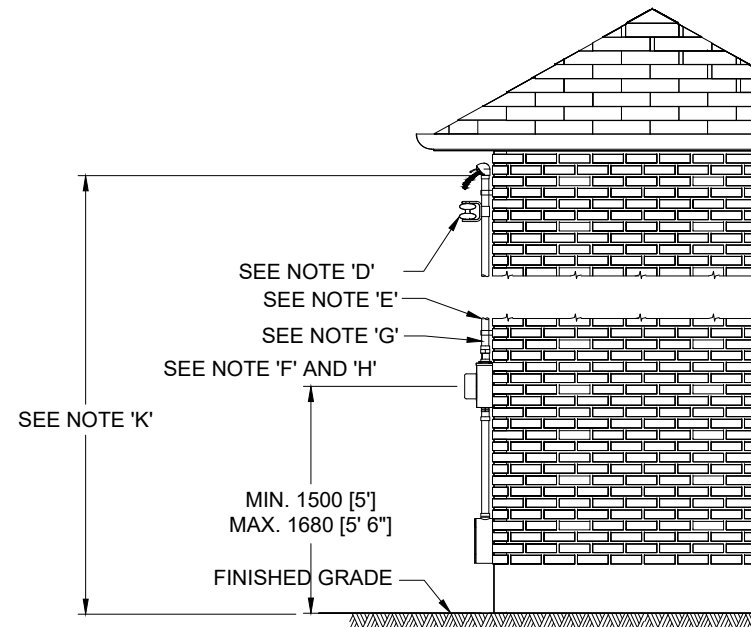

RESIDENTIAL TWO-STOREY

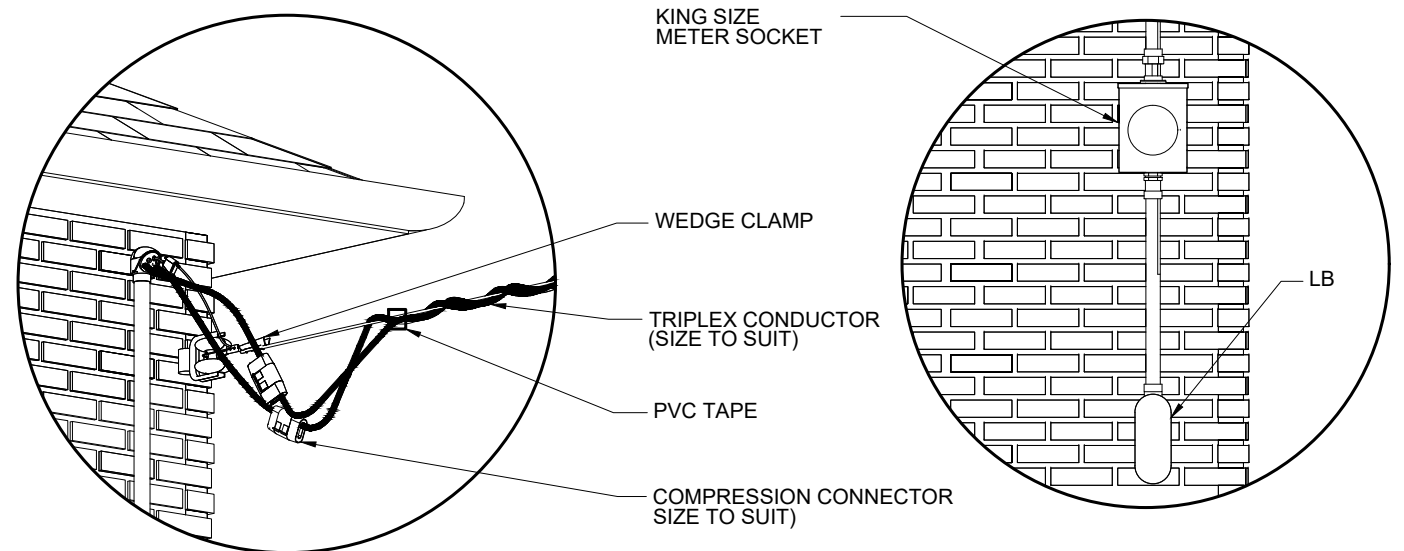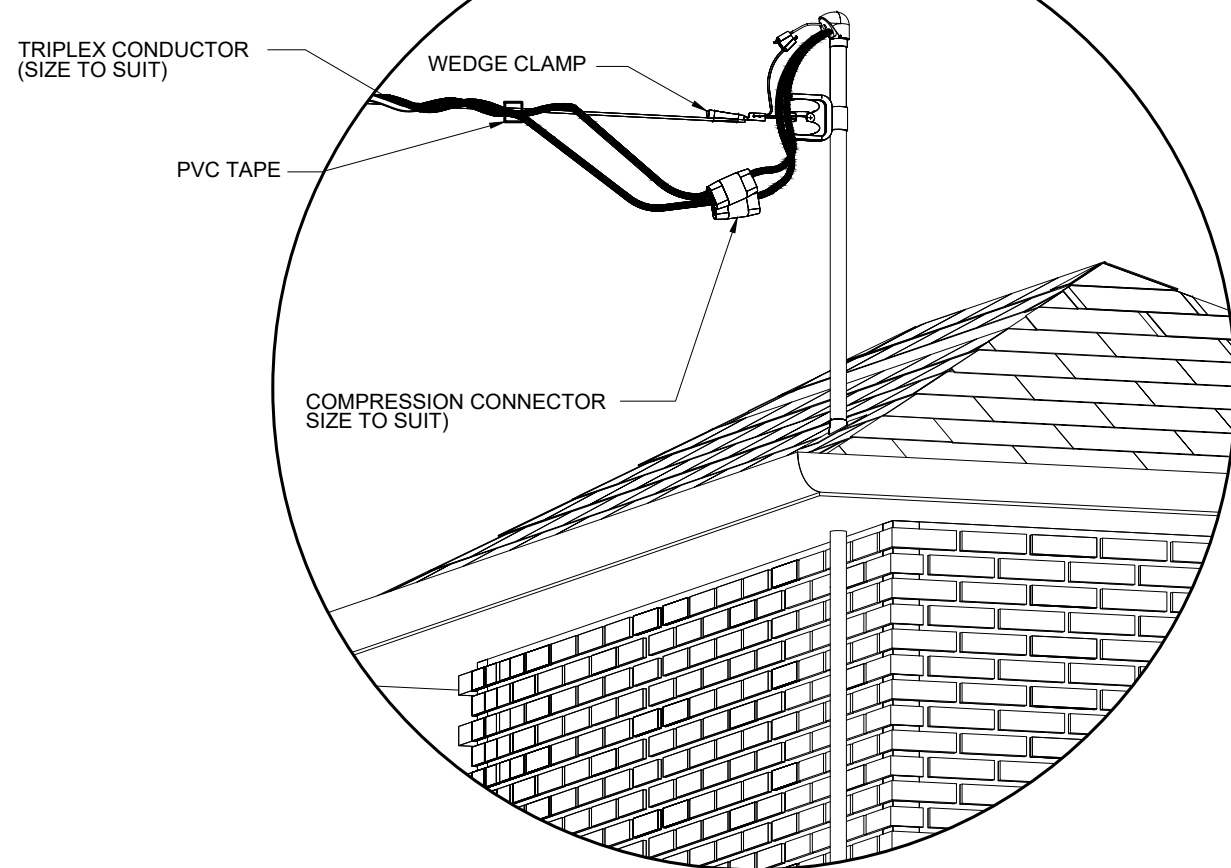

REVISIONS				PREP	CHKD	APPD	 www.hydroottawa.com	TITLE	
REV: 1	DATE: 2020-06-18	EV	KS/PL	RH				ENGINEERING SPECIFICATION	
CHANGE:	UPDATED NOTE 'H' AND 'K', UPDATED TITLE							RES OH 120V/240V, 1PH, 3W ≤ 200A SERVICE ENTRANCE	
REV: CHANGE:	DATE:							CONSTRUCTION DETAIL	
REV: CHANGE:	DATE:						PREP: G. MOLNAR CHKD: S. McNALLY P.Eng APPD: C. MALONE P.Eng DATE: 2016-01-13 SCALE: N.T.S. @ ANSI B	NO:	
								ECS0040	1 OF 1 REV: 1

LAST SAVED: 2020-06-22 1:27 PM