


For Hydro Ottawa Use Only Copyright 2008

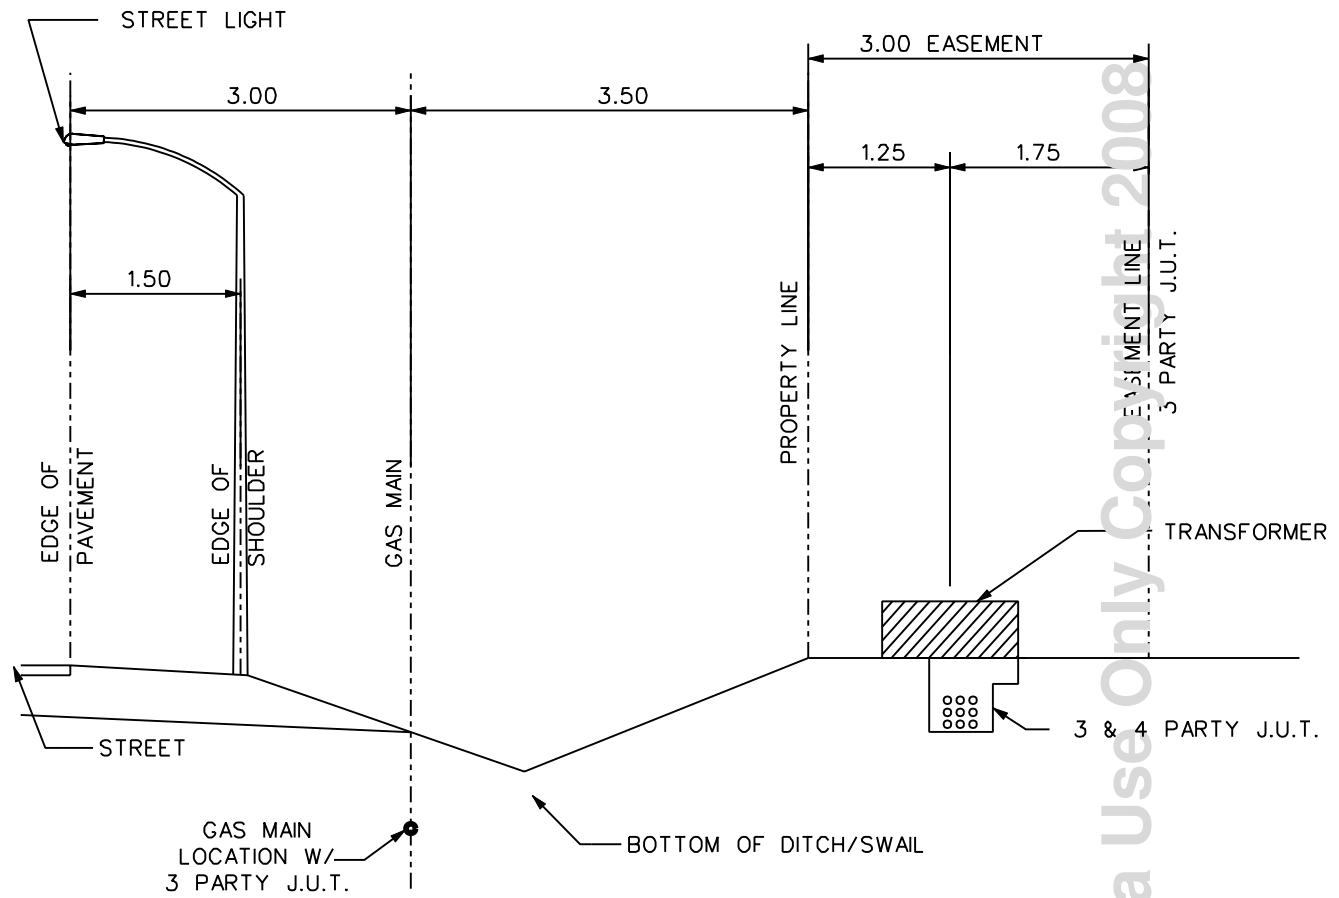

INSTALLATION PROCEDURES:

- A. OUTDOOR PADMOUNTED TRANSFORMERS SHALL BE LOCATED/INSTALLED AS PER THE ONTARIO ELECTRICAL SAFETY CODE, SECTION 26-242.
- B. INSTALL BIO-GUARD TO PREVENT TREE ROOTS FROM INTERFERING WITH JOINT UTILITY TRENCH WHEN MAIN TAP ROOT IS WITHIN 1.5m OF EDGE OF JOINT USE TRENCH.
- C. ALL UNITS ARE IN METERS UNLESS OTHERWISE SPECIFIED.
- D. FOUR PARTY TRENCH INCLUDES GAS MAIN.

SDATES

SDATES

SDATES

REVISIONS		PREP	CHKD	APPD	<p>TITLE</p> <p>ENGINEERING SPECIFICATION</p> <p>RURAL ESTATE LOT XFMR AND TRENCH LOCATION</p> <p>CONSTRUCTION DETAIL</p>	NO:	<p>GCG0005</p>	<table border="1"> <tr> <td>1</td> <td>REV:</td> </tr> <tr> <td>OF</td> <td></td> </tr> <tr> <td>1</td> <td>0</td> </tr> </table>	1	REV:	OF		1	0
1	REV:													
OF														
1	0													
REV: CHANGE:	DATE: YYYY-MM-DD								<p>WWW.HYDRO-OTTAWA.COM</p>					
REV: CHANGE:	DATE: YYYY-MM-DD				PREP: G. MOLNAR									
REV: CHANGE:	DATE: YYYY-MM-DD				CHKD: K. MCROBERTS									
REV: CHANGE:	DATE: YYYY-MM-DD				APPD: C. MALONE P. Eng									
					DATE: 2008-11-05									
					SCALE: N.T.S. @ ANSIA									