



INSTALLATION PROCEDURES:

- A. ALL UNITS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
- B. REFER TO GCS0038 FOR TREE PROXIMITY SPECIFICATION.
- C. OUTDOOR PADMOUNTED TRANSFORMERS SHALL BE LOCATED/INSTALLED AS PER THE ONTARIO ELECTRICAL SAFETY CODE, SECTION 26-242.
- D. MINIMUM CLEARANCE REQUIRED FOR GAS MAIN IN 4 PARTY J.U.T. IS 1000mm FROM ANY BUILDING FOUNDATION/STAIRS.

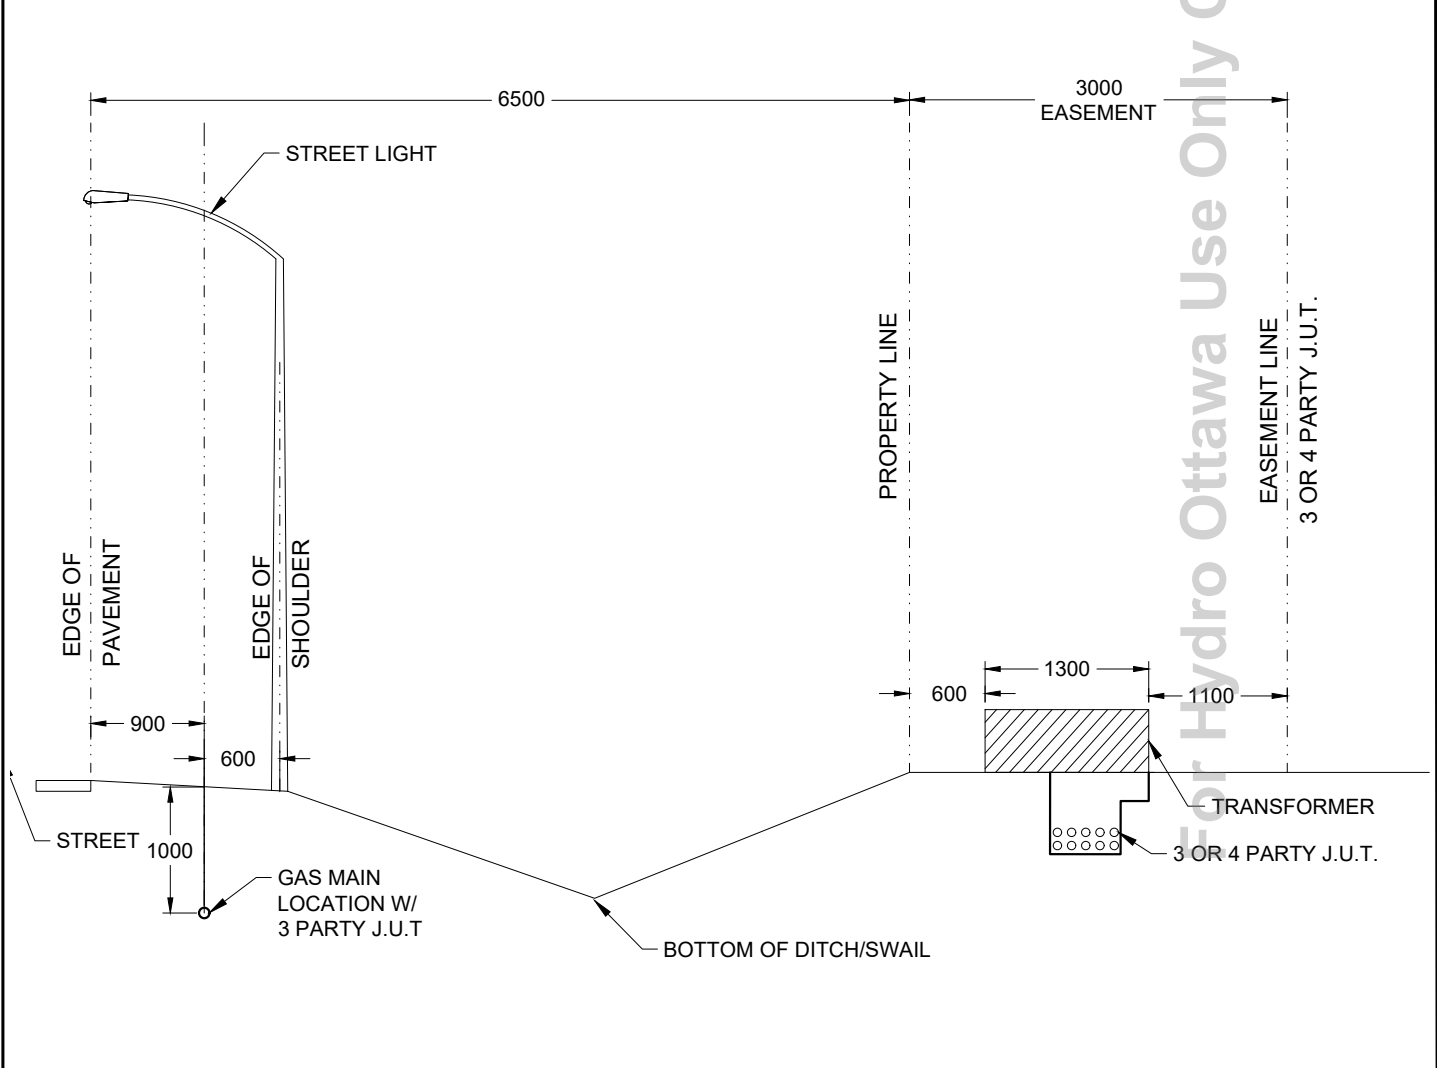

G:\4.2.3 TECH STD & MAT\01 STDS\01 HOLIG-GENERAL\CONSTRUCTION\GCG0005 R1 RURAL ESTATE LOT XFMR AND TRENCH LOCATION.DWG

REVISIONS				PREP	CHKD	APPD	TITLE							
REV: 1	DATE: 2020-02-21	EV	AK	BDH	 WWW.HYDROOTTAWA.COM		ENGINEERING SPECIFICATION RURAL ESTATE LOT XFMR AND TRENCH LOCATION CONSTRUCTION DETAIL							
CHANGE: MODIFIED DUCT LAYOUT FROM 3x3 TO 2x5 MOVED GAS MAIN LOCATION														
REV: CHANGE:	DATE:													
REV: CHANGE:	DATE:				PREP: G. MOLNAR	NO: GCG0005		<table border="1"> <tr> <td>1</td> <td>REV:</td> </tr> <tr> <td>OF</td> <td>1</td> </tr> <tr> <td>1</td> <td></td> </tr> </table>	1	REV:	OF	1	1	
1	REV:													
OF	1													
1														
REV: CHANGE:	DATE:				CHKD: K. McROBERTS									
REV: CHANGE:	DATE:				APPD: C. MALONE P. Eng									
REV: CHANGE:	DATE:				DATE: 2008-11-05									
REV: CHANGE:	DATE:				SCALE: N.T.S. @ ANSI A									