


- NOTES:**
- SECONDARY LINE SIDE CONNECTIONS TO METER SOCKET BASE MADE BY HYDRO OTTAWA AND ARE PROVIDED FOR ILLUSTRATIVE PURPOSES ONLY. LOAD SIDE CONNECTIONS BY CUSTOMER'S ELECTRICAL CONTRACTOR.
  - REFER TO HYDRO OTTAWA REVENUE METERING SPECIFICATION GCS0008. FOR METER EQUIPMENT INSTALLATION REQUIREMENTS, REFER TO TABLE 3.

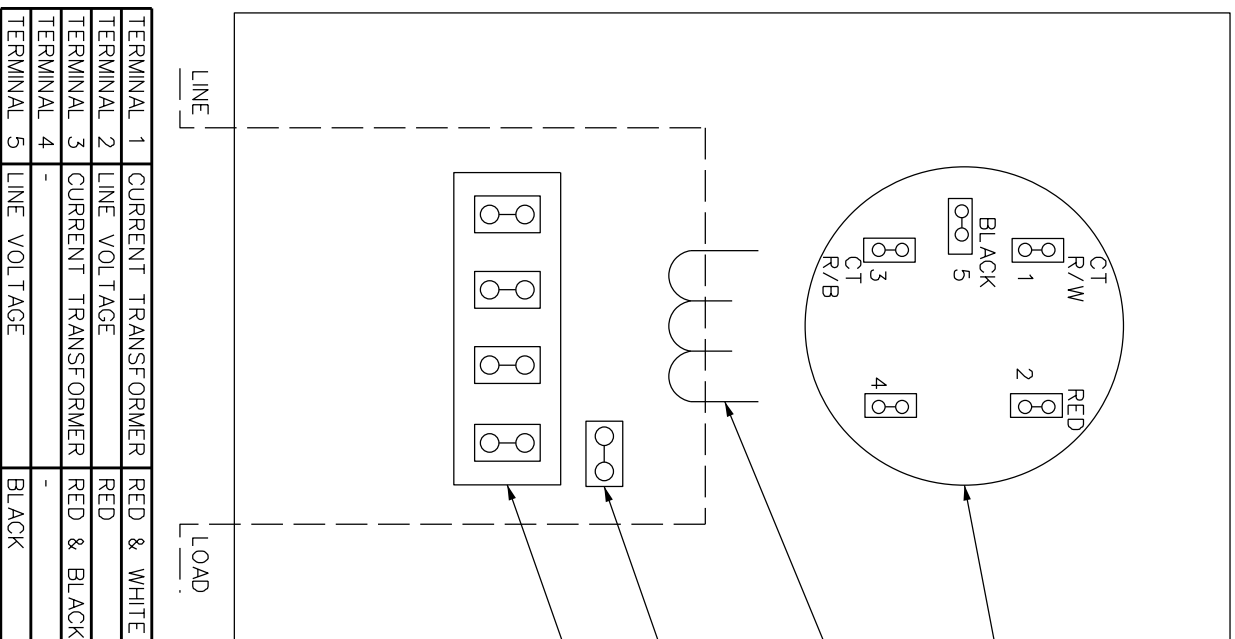

ENCLOSURE

SELF SHORTING  
(ON LEFT SIDE)  
5-JAW METER  
SOCKET

THREE WIRE CURRENT  
TRANSFORMER SUPPLIED  
AND INSTALLED BY  
HYDRO OTTAWA

NEUTRAL BLOCK

FOUR POLE METER TEST  
SWITCH SUPPLIED WITH  
METERING ENCLOSURE

TERMINAL 1	CURRENT TRANSFORMER	RED & WHITE
TERMINAL 2	LINE VOLTAGE	RED
TERMINAL 3	CURRENT TRANSFORMER	RED & BLACK
TERMINAL 4	-	-
TERMINAL 5	LINE VOLTAGE	BLACK

REVISONS	PREP	CHKD	APPD	TITLE	NO:	REV:
REV: 1 DATE: 2007-08-01 CHANGE: NOTES LAYOUT ANNOTATION DETAIL	CP	CP	CSM	 www.hydroottawa.com <b>ENGINEERING SPECIFICATION</b> <b>COM/RES 120V/240V, 1PH, 3W, 400A</b> <b>TRANSFORMER RATED SERVICE</b> <b>USING COMBINATION</b> <b>METER SOCKET BASE</b> <b>CONSTRUCTION DETAIL</b>	1	1
REV: 2 DATE: 2014-09-03 CHANGE: ADDED 5TH JAW, REVISED NOTES	SK	SMC	CSM		1	3
REV: 3 DATE: 2016-01-13 CHANGE: UPDATED TITLE	JD	SMC	CSM		1	3

 www.hydroottawa.com PREP: F. BOLO CHKD: B. PECK	APPD: C. MALONE DATE: 2003-07-22 SCALE: N.T.S. & ANSIA
---	--