


- NOTES:**
- A. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE SPECIFIED.
 - B. SERVICE SHALL BE "COLD" METERED.
 - C. CONDUIT METER SOCKET AND SERVICE ENTRANCE ENCLOSURE SUBJECT TO REQUIREMENTS OF HYDRO OTTAWA REVENUE METERING SPECIFICATION GCS0008.
 - D. METER SOCKET AND SERVICE ENTRANCE DISCONNECT SHALL BE NEMA-3R RATED OR BETTER.
 - E. MINIMUM OF 1000 [31.4"] OF CLEARANCE REQUIRED IN FRONT OF SERVICE ENTRANCE DISCONNECT AND REVENUE METER.
 - F. RIGID MINIMUM SCHEDULE 80 PVC CONDUIT AS PER HYDRO OTTAWA AND ONTARIO ELECTRICAL SAFETY CODE (OESC) REQUIREMENTS.
 - G. EXPANSION COUPLING AS PER OESC.
 - H. ALL ENCLOSURES GROUNDED AS PER HYDRO OTTAWA AND OESC REQUIREMENTS.
 - I. SERVICE ENTRANCE DISCONNECT CONNECTED ELECTRICALLY ON "LOAD" SIDE OF METER WITH FACTORY INSTALLED OVER-CURRENT PROTECTION SIZED AS PER ESA AND OESC REQUIREMENTS.
 - J. MOUNTED EQUIPMENT SHALL NOT EXTEND PAST TOP OF POLE.

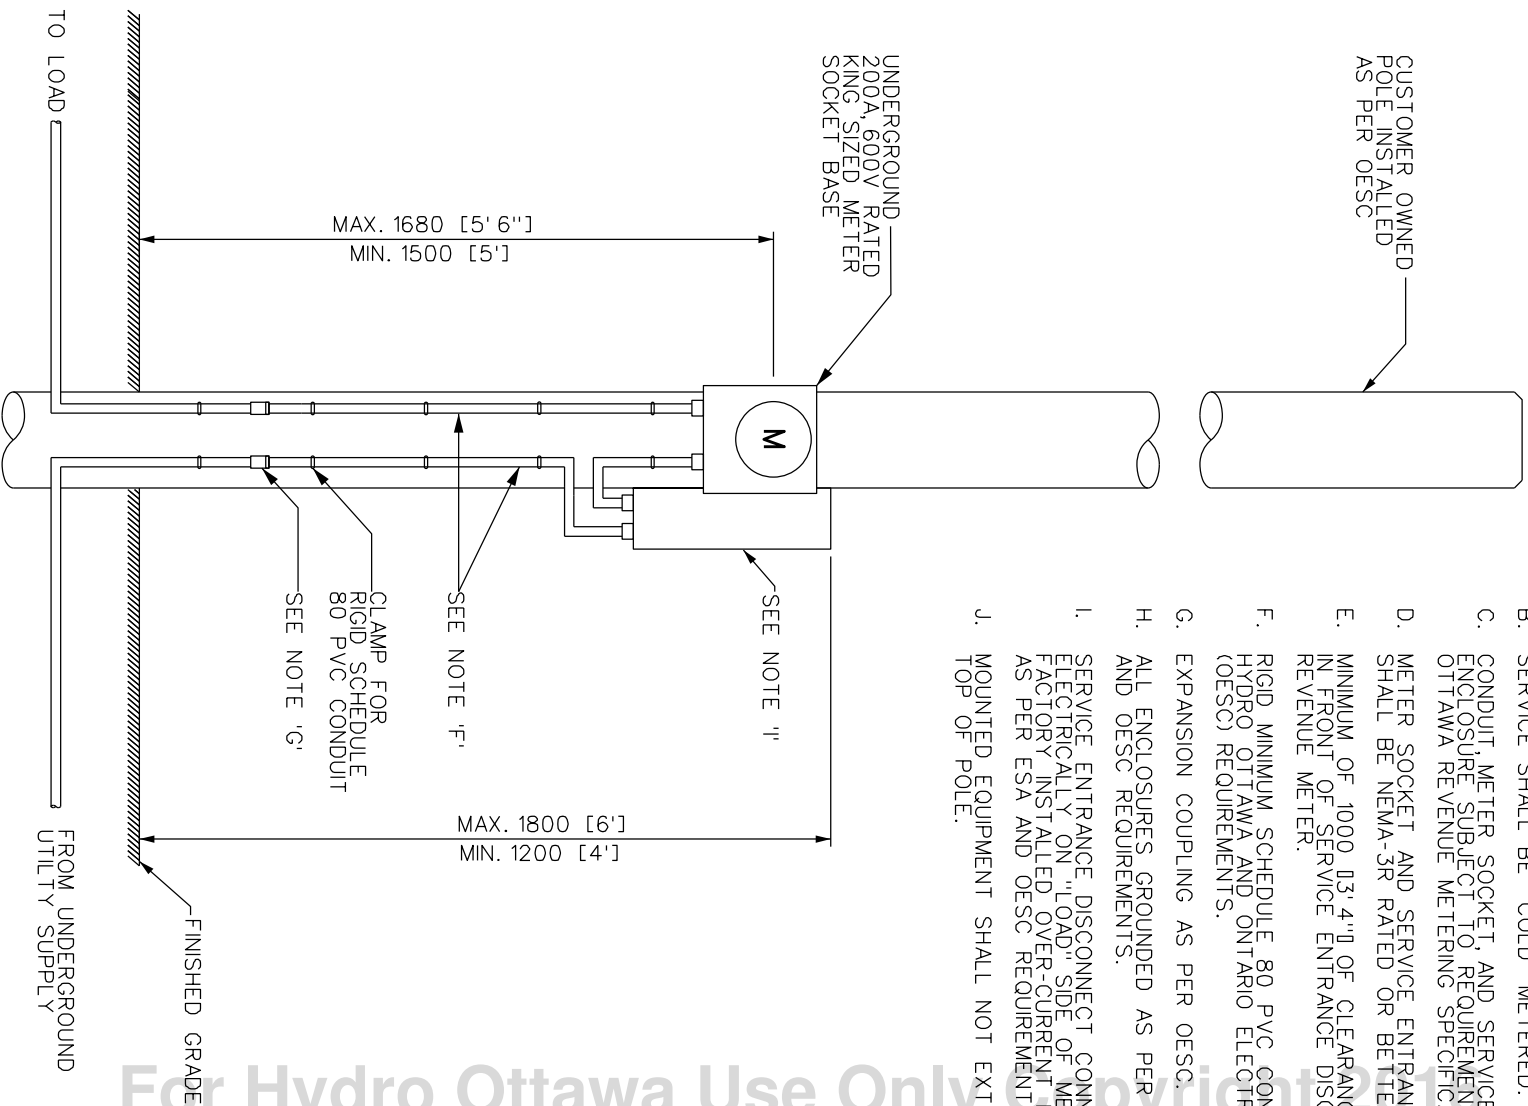

REVISONS	PREP	CHKD	APPD
DATE	JD	SMC	CSM
REV: 1 CHANGE: UPDATE TITLE			
DATE: 2016-02-05			
REV: CHANGE:			
DATE: YYYY-MM-DD			
REV: CHANGE:			
DATE: YYYY-MM-DD			

HydroOttawa
www.hydroottawa.com

PREP: M. MALONEY
CHKD: S. McNALLY (E.I.T.)
APPD: C. MALONE P. Eng.

DATE: 2014-09-03
SCALE: N.T.S. @ ANSIA

ENGINEERING SPECIFICATION

COM UG 120V/240V, 1PH, 3W, ≤ 200A, SERVICE ENTRANCE DISCONNECT AND METERING ON CUSTOMER OWNED POLE

CONSTRUCTION DETAIL

MCS0071

1	REV:
1	OF
1	1