

FIG. 1 REVENUE METERING EQUIPMENT

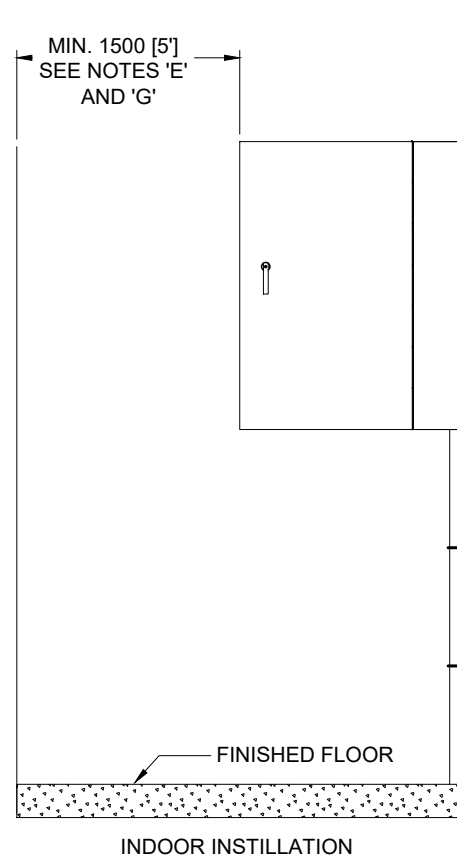
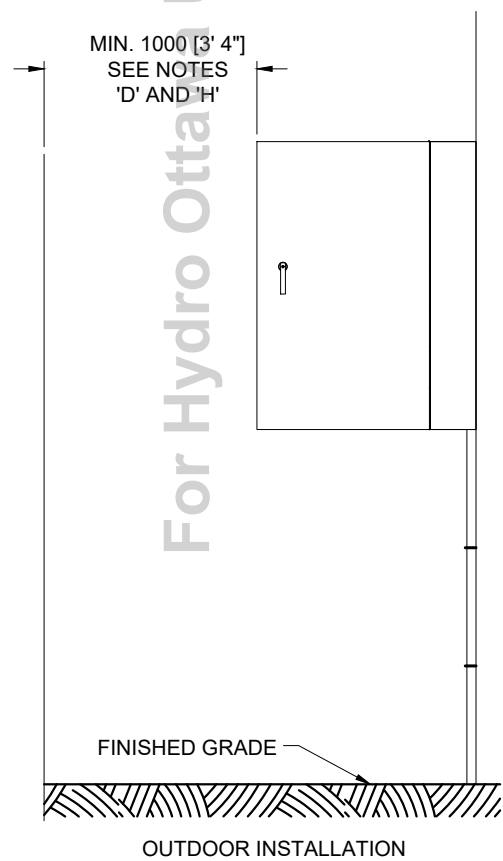



FIG. 2 WALL MOUNTED REVENUE METERING ENCLOSURE (ENCLOSURE SHOWN WITH DOOR OPENED)

NOTES:

- A. ALL DIMENSIONS ARE IN MILLIMETRES, UNLESS OTHERWISE SPECIFIED.
- B. THE INTENT OF THE CLEARANCES SPECIFIED IS TO PROVIDE A FLAT AND LEVEL SURFACE, IN FRONT OF HYDRO OTTAWA REVENUE METERING EQUIPMENT FOR THE USE OF HYDRO OTTAWA PERSONNEL ACCESSING THE REVENUE METERING EQUIPMENT.
- C. MINIMUM OF 1000 [3' 4\"] OF CLEARANCE BETWEEN HYDRO OTTAWA OWNED REVENUE METERING EQUIPMENT AND PROPERTY LINE OF PREMISE SERVED, CUSTOMER OWNED PLANTS, TREES, SHRUBS, FENCES, AND STRUCTURES REQUIRED.
- D. MINIMUM OF 1000 [3' 4\"] OF CLEARANCE BETWEEN EDGE OF DOOR, OF THE ENCLOSURE USED FOR REVENUE METERING EQUIPMENT, WHILE IN ITS OPEN POSITION AND THE PROPERTY LINE OF THE PREMISE SERVED, CUSTOMER OWNED PLANTS, TREES, SHRUBS, FENCES, AND STRUCTURES REQUIRED.
- E. HYDRO OTTAWA OWNED REVENUE METERING EQUIPMENT, INSTALLED AT AN INDOOR LOCATION NEAR A DOOR USED TO CONTROL ACCESS TO THE LOCATION, SHALL REMAIN ACCESSIBLE WHILE THE DOOR IS IN ITS OPEN POSITION.
- F. MINIMUM OF 1500 [5'] OF CLEARANCE IN FRONT OF REVENUE METERING EQUIPMENT REQUIRED.
- G. MINIMUM OF 1500 [5'] OF CLEARANCE IN FRONT OF EDGE OF DOOR, OF THE ENCLOSURE USED FOR REVENUE METERING EQUIPMENT WHILE IN ITS OPEN POSITION, REQUIRED.
- H. REFER TO HYDRO OTTAWA SPECIFICATION MCS0106 FOR MORE INFORMATION ON MINIMUM OUTDOOR CLEARANCES NEXT TO REVENUE METERING EQUIPMENT.
- I. MINIMUM SETBACK OF 1200[4'] BETWEEN BUILDING AND PROPERTY LINE TO ALLOW FOR REVENUE METERING EQUIPMENT.

REVISIONS				PREP	CHKD	APPD	 WWW.HYDROOTTAWA.COM	TITLE			
REV: 1	DATE: 2020-06-18	EV	PL	RH				ENGINEERING SPECIFICATION AGR/COM/ERF/RES MINIMUM CLEARANCE IN FRONT OF REVENUE METERING EQUIPMENT CONSTRUCTION DETAIL			
CHANGE:	ADDED FIGURE NUMBERS AND REVISED NOTE "I"										
REV:	DATE:							PREP: G. MOLNAR			
CHANGE:							CHKD: S. McNALLY P.Eng				
REV:	DATE:						APPD: C. MALONE P.Eng				
CHANGE:							DATE: 2016-03-24				
							SCALE: N.T.S. @ ANSI B				
								NO:	MCS0105	1 OF 1	REV: 1