

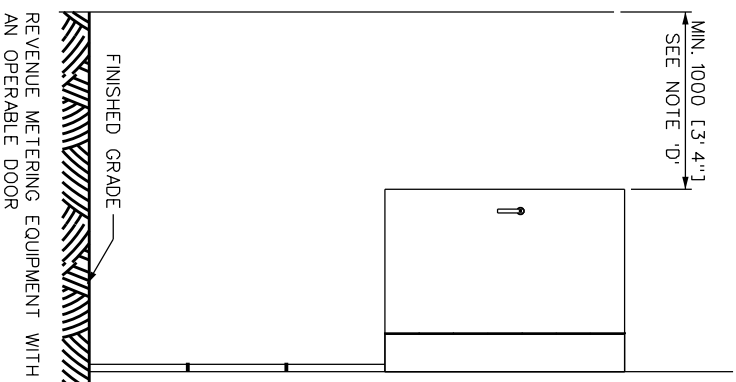
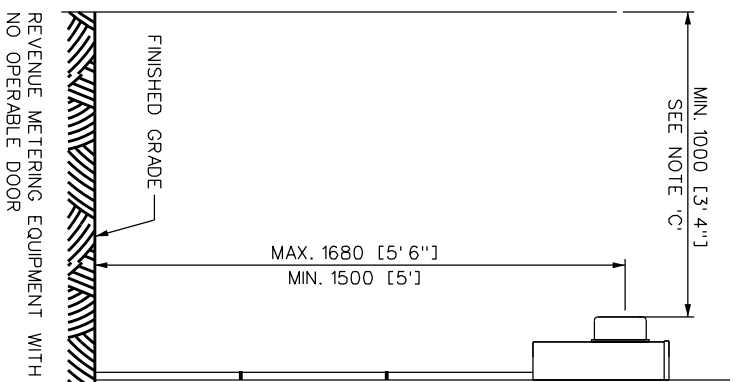


OUTDOOR LOCATION

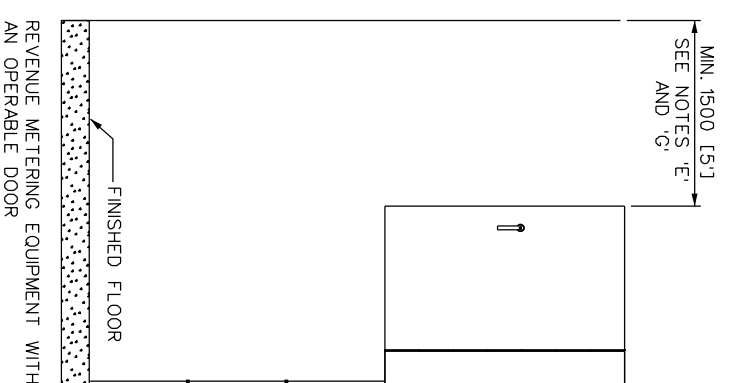


INDOOR LOCATION

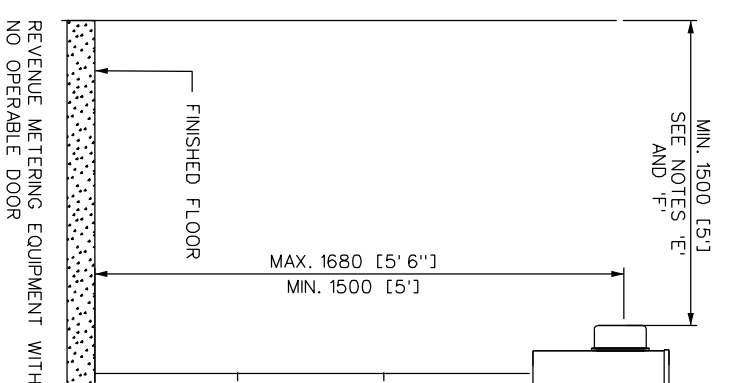

NOTES:

- A. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE SPECIFIED.
- B. THE INTENT OF THE CLEARANCES SPECIFIED IS TO PROVIDE A FLAT AND LEVEL SURFACE, IN FRONT OF HYDRO OTTAWA REVENUE METERING EQUIPMENT FOR THE USE OF HYDRO OTTAWA PERSONNEL ACCESSING THE REVENUE METERING EQUIPMENT.
- C. MINIMUM OF 1000 [3' 4"] OF CLEARANCE BETWEEN HYDRO OTTAWA OWNED REVENUE METERING EQUIPMENT AND PROPERTY LINE OF PREMISE SERVED, CUSTOMER OWNED PLANTS, TREES, SHRUBS, FENCES, AND STRUCTURES REQUIRED.
- D. MINIMUM OF 1000 [3' 4"] OF CLEARANCE BETWEEN EDGE OF DOOR, OF THE EXTERNAL ENCLOSURE USED FOR HYDRO OTTAWA OWNED REVENUE METERING EQUIPMENT, WHILE IN ITS OPEN POSITION AND THE PROPERTY LINE OF THE PREMISE SERVED, CUSTOMER OWNED PLANTS, TREES, SHRUBS, FENCES, AND STRUCTURES REQUIRED.
- E. HYDRO OTTAWA OWNED REVENUE METERING EQUIPMENT, INSTALLED AT AN INDOOR LOCATION NEAR A DOOR USED TO CONTROL ACCESS TO THE LOCATION, SHALL REMAIN ACCESSIBLE WHILE THE DOOR IS IN ITS OPEN POSITION.
- F. MINIMUM OF 1500 [5'] OF CLEARANCE IN FRONT OF REVENUE METERING EQUIPMENT REQUIRED.
- G. MINIMUM OF 1500 [5'] OF CLEARANCE IN FRONT OF EDGE OF DOOR, OF THE ENCLOSURE USED FOR REVENUE METERING EQUIPMENT WHILE IN ITS OPEN POSITION, REQUIRED.
- H. REFER TO HYDRO OTTAWA SPECIFICATIONS GCS0008, MCS0099, MCS0106 AND MCS0105 FOR MORE INFORMATION ON CLEARANCE REQUIREMENTS.

REVISIONS		PREP	CHKD	APPD	TITLE
REV: CHANGE:	DATE: YYYY-MM-DD				ENGINEERING SPECIFICATION AGR/COM/ERF/RES MINIMUM CLEARANCE IN FRONT OF REVENUE METERING EQUIPMENT CONSTRUCTION DETAIL MCS0105
REV: CHANGE:	DATE: YYYY-MM-DD				
REV: CHANGE:	DATE: YYYY-MM-DD				
REV: CHANGE:	DATE: YYYY-MM-DD				
 www.hydroottawa.com					NO:
PREP: G. MOLNAR P.Eng. CHKD: S. McNALLY P.Eng. APPD: C. MALONE P.Eng. DATE: 2016-03-24 SCALE: N.T.S. @ ANSIB					1 REV: OF 1 0