



NOTES:

- A. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE SPECIFIED.
- B. MINIMUM HORIZONTAL CLEARANCE, FROM DG SYSTEM FUSED DISCONNECT OR DG SOURCE FUSED DISCONNECT, OF:
 - i. 1000 [3'4"] FROM NATURAL GAS RELATED EQUIPMENT REQUIRED.
 - ii. 3000 [10'] FROM PROPANE RELATED EQUIPMENT REQUIRED.
- C. REFER TO HYDRO OTTAWA SPECIFICATIONS GCS0008, MCS0100, MCS0101, MCS0106, AND MCS0107 FOR MORE INFORMATION.

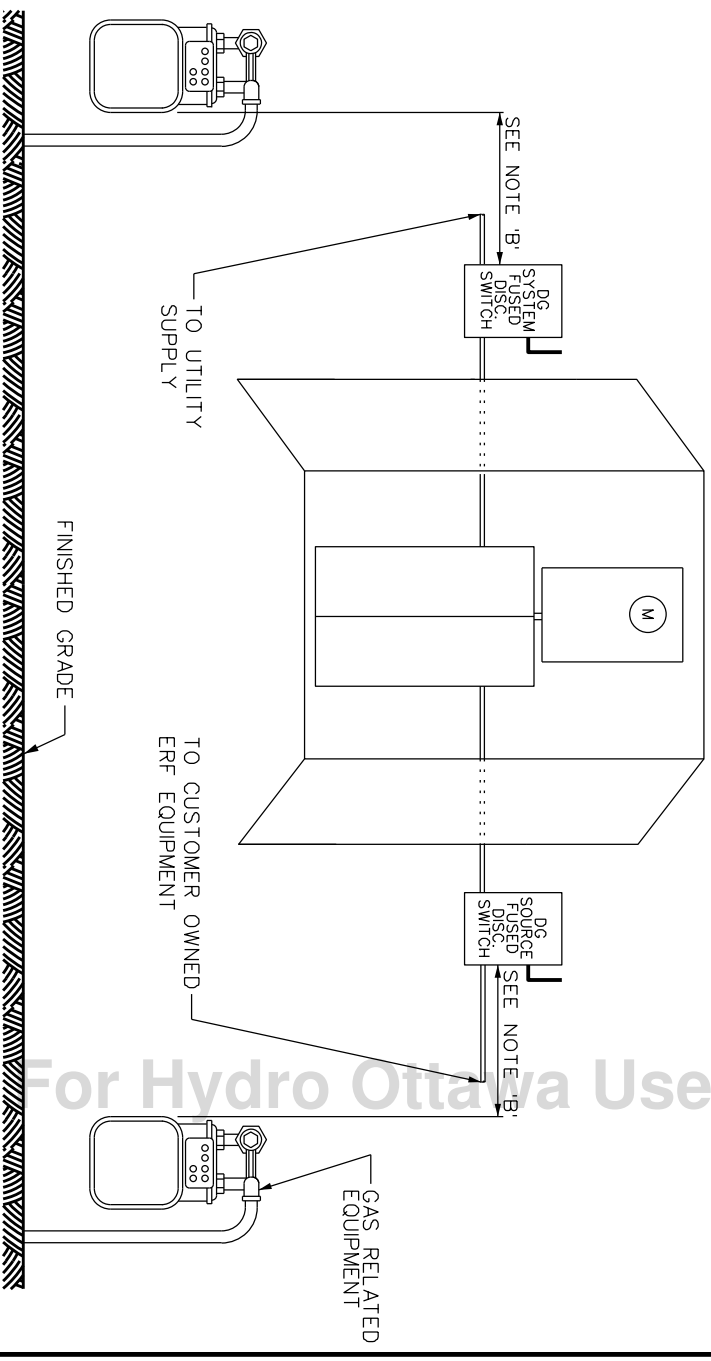

| REV: | DATE: | PREP | CHKD | APPD | TITLE |
|---------|------------------|------|------|------|---|
| CHANGE: | DATE: YYYY-MM-DD | | | | <p>ENGINEERING SPECIFICATION ERF OUTDOOR MOUNTED DISCONNECT MINIMUM CLEARANCE FROM GAS RELATED EQUIPMENT CONSTRUCTION DETAIL</p> |
| REV: | DATE: YYYY-MM-DD | | | | |
| CHANGE: | DATE: YYYY-MM-DD | | | | |
| REV: | DATE: YYYY-MM-DD | | | | NO: |
| CHANGE: | DATE: YYYY-MM-DD | | | | NO: |


Hydro Ottawa
 www.hydroottawa.com
 PREP: G. MOLNAR P.Eng.
 CHKD: S. McNALLY
 APPD:
 DATE: 2016-03-24
 SCALE: N.T.S. @ ANSIA

| | | | |
|----------------|--|-----|------|
| NO: | | NO: | |
| MCS0108 | | 1 | REV: |
| | | 0 | 0 |