


For Hydro Ottawa Use Only Copyright 2019

SECONDARY ELECTRICAL CLOSET

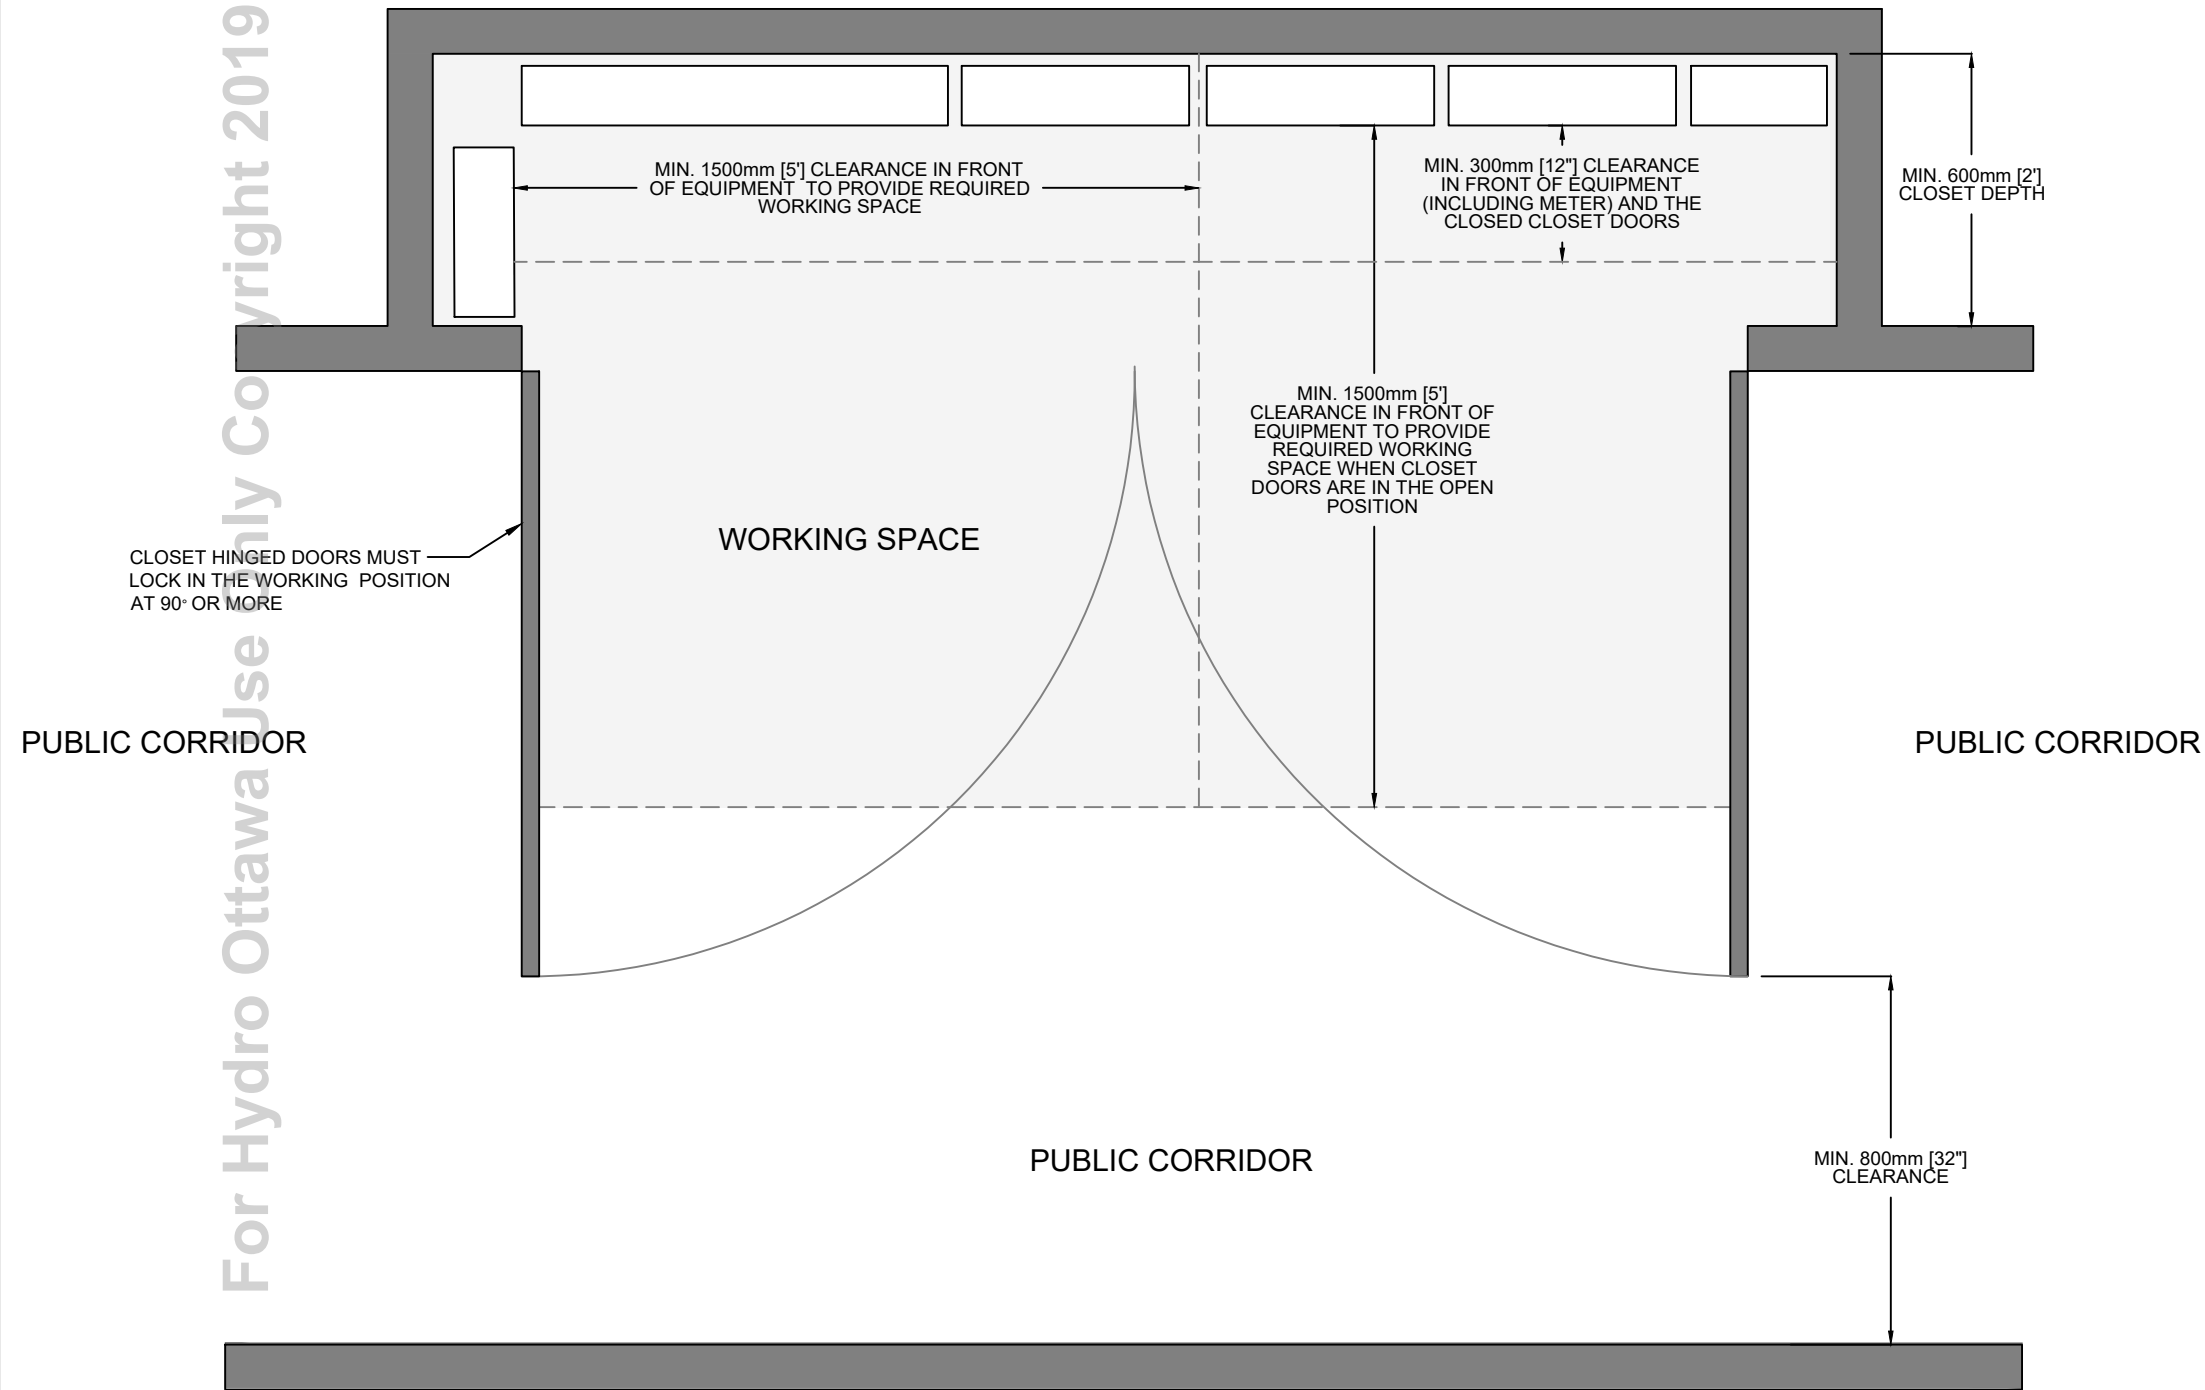

NOTES:

- A. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
- B. INSTALLATION SHALL MEET OR EXCEED ALL OESC AND OBC REQUIREMENTS.
- C. CLEARANCE REQUIREMENTS ARE APPLICABLE FOR HYDRO OTTAWA OWNED OR OPERATED EQUIPMENT.
- D. CLOSET DOORS SHALL NOT BLOCK OR INTERFERE WITH ADJACENT DOORS, UNITS, STAIRWELLS OR PASSAGEWAYS WHEN IN THEIR WORKING POSITION.
- E. THERE SHALL BE NO ADJACENT DOORWAYS, CORRIDORS OR ELEVATORS LOCATED SUCH THAT THE NORMAL PATH OF TRAVEL ENTERING OR EXITING THEM WOULD CROSS THROUGH OR INTO THE REQUIRED WORKING SPACE.
- F. THERE SHALL BE A CLEAR OPENING WITHIN THE CORRIDOR OF NOT LESS THAN 800MM [32"] WHEN THE DOORS ARE IN ITS OPEN POSITION.
- G. ALL SECONDARY ELECTRICAL CLOSETS SHALL BE SUBJECT TO THE FOLLOWING:
 - a. SHALL HAVE A MINIMUM CEILING HEIGHT OF 2130MM [7'] FROM THE FINISHED FLOOR.
 - b. SHALL HAVE ADEQUATE LIGHTING AT THE WORKING LEVEL
 - c. SHALL BE A HEATED ELECTRICAL CLOSET.
- H. THE ELECTRICAL CLOSET DOORS SHALL BE EQUIPPED WITH A DUAL LOCKING SYSTEM ACCEPTABLE TO HOL, OR SECURE KEY BOX (ALSO KNOWN AS A "LOCK BOX") SUCH THAT BOTH HOL AND CUSTOMER MAY HAVE ACCESS TO THEIR METER OR EQUIPMENT.
- I. DOORS SHALL BE HUNG ON TAMPER PROOF HINGES TO PREVENT ACCESS BY UNAUTHORIZED PEOPLE.

LAST SAVED: 2019-12-16 8:06 AM

REVISIONS		PREP	CHKD	APPD
REV: 1 CHANGE: UPDATED NOTES	DATE: 2019-12-14	EV	AD	BDH
REV: CHANGE:	DATE:			
REV: CHANGE:	DATE:			

PREP: E. VEH
CHKD: B. HARRINGTON
APPD: E. DONKERSTEEG P. Eng
DATE: 2018-08-08
SCALE: N.T.S. @ ANSI B

TITLE	
ENGINEERING SPECIFICATION GENERAL SECONDARY SERVICE ELECTRICAL CLOSET CLEARANCES FOR METER CENTRE AND MCMU INSTALLATIONS CONSTRUCTION DETAIL	
NO:	MCS0115
REV:	1