


SLOPING OF TRENCH WALLS SHALL CONFORM TO REQUIREMENTS SPECIFIED IN THE OCCUPATIONAL HEALTH & SAFETY ACT.

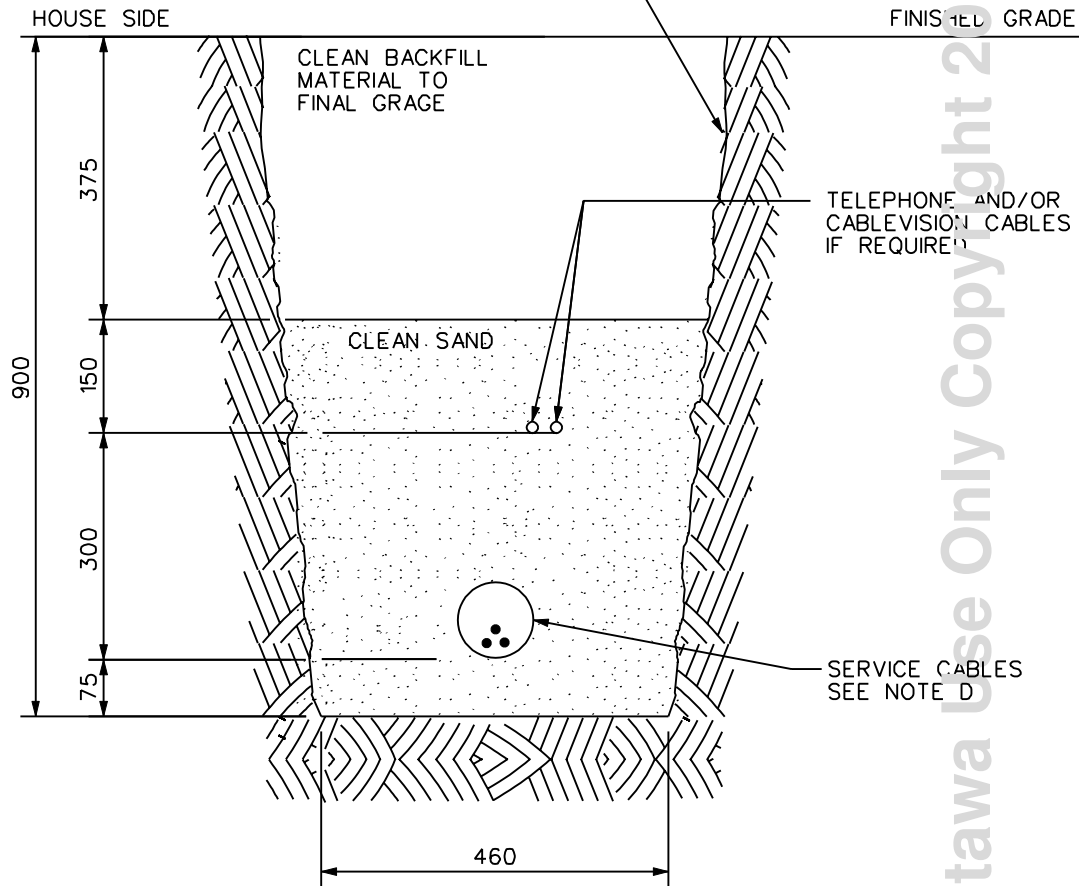

**SECTION VIEW
TRENCH**

NOTES:

- A. UNDERGROUND CONDUCTOR TO BE DIRECT BURIED FROM PROPERTY LINE TO METER BASE UNLESS OTHERWISE NOTED ON DRAWING
- B. SPLICE PITS A (MINIMUM DIMENSION OF 1200mm x 1200mm) SHALL BE COMPLETELY BACKFILLED WITH CLEAN SAND.
- C. TRENCH AND BACKFILL MATERIAL TO BE INSPECTED BY HYDRO OTTAWA PRIOR TO BACKFILLING
- D. INSTALL UNDERGROUND CABLE IN 100mm (4") DB2 DUCT TO WITHIN 1200mm (4') OF METER BASE WHEN ADJACENT TO OR UNDER SURFACES SUCH AS DRIVEWAYS, SIDEWALKS, LARGE OBSTACLES (SUCH AS TREES, HEDGES, OR DECORATIVE STONE), ESTATE OR INFILL TYPE LOTS OR FOR LENGTHS OF CABLE >30M ON PRIVATE PROPERTY. A 9.65mm [3/8"] ROPE SHALL BE INSTALLED IN THE DUCT.
- E. ALL MEASUREMENTS IN MILLIMETERS UNLESS OTHERWISE NOTED.
- F. ALL BACKFILL MATERIAL MUST BE APPROVED BY HYDRO OTTAWA INSPECTOR: FOR ACCEPTABLE BACKFILL MATERIAL, SEE HYDRO OTTAWA SPECIFICATION DOCUMENT GCS0001 APPENDIX "A".

25/10/2010 7:53:05 AM

REVISIONS			PREP	CHKD	APPD	TITLE						
REV:	DATE:	CHANGE:	MG	CP	CSM							
REV: 4	DATE: 2008-10-03	CHANGE: UPDATED NOTE 'F' REF:: UDS0014				ENGINEERING SPECIFICATION TRENCH JOINT UTILITY 3 PARTY SERVICE RESIDENTIAL CONSTRUCTION DETAIL						
REV: 5	DATE: 2010-05-27	CHANGE: TITLE CHANGE	FB	RW	CSM							
REV: 6	DATE: 2010-10-22	CHANGE: NOTE "D" REVISED	FB	KM	CSM	PREP: G. MOLNAR CHKD: C. PROULX APPD: C. MALONE P. Eng DATE: 2002-10-09 SCALE: N.T.S. @ ANSIA						
						NO: UDS0003						
						<table border="1"> <tr> <td>1</td> <td>REV:</td> </tr> <tr> <td>OF</td> <td></td> </tr> <tr> <td>1</td> <td>6</td> </tr> </table>	1	REV:	OF		1	6
1	REV:											
OF												
1	6											