



NOTES:

- A. DUCT SADDLE RADIUS IS CRITICAL.
- B. SPACERS TO BE USED WITH 100mm TYPE EBI PVC DUCTING C.S.A. SPECIFICATION C22.3 No. 211.1 SUPPLIED BY CONTRACTOR.
- C. REFER TO DWG. UDS0001 FOR SPACER ARRANGEMENT IN DUCT BANK.
- D. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED.

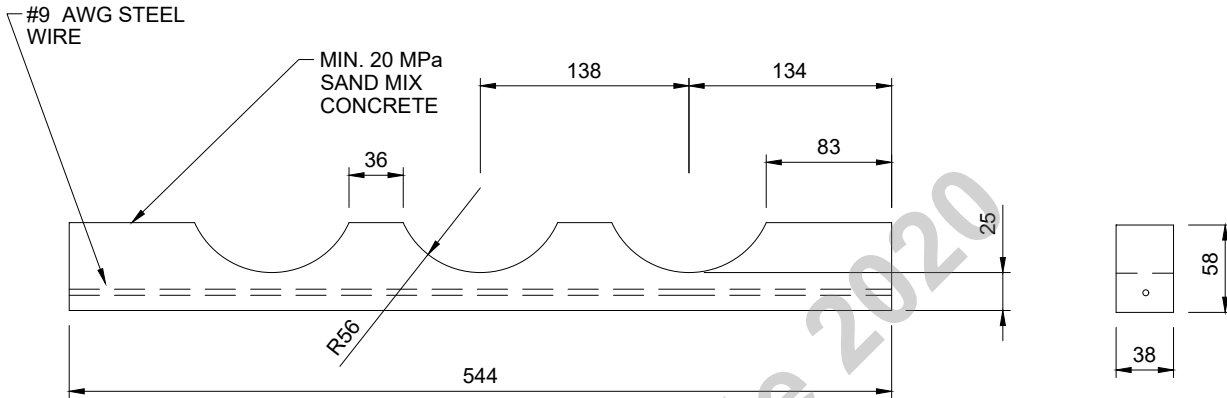


INTERMEDIATE SPACER

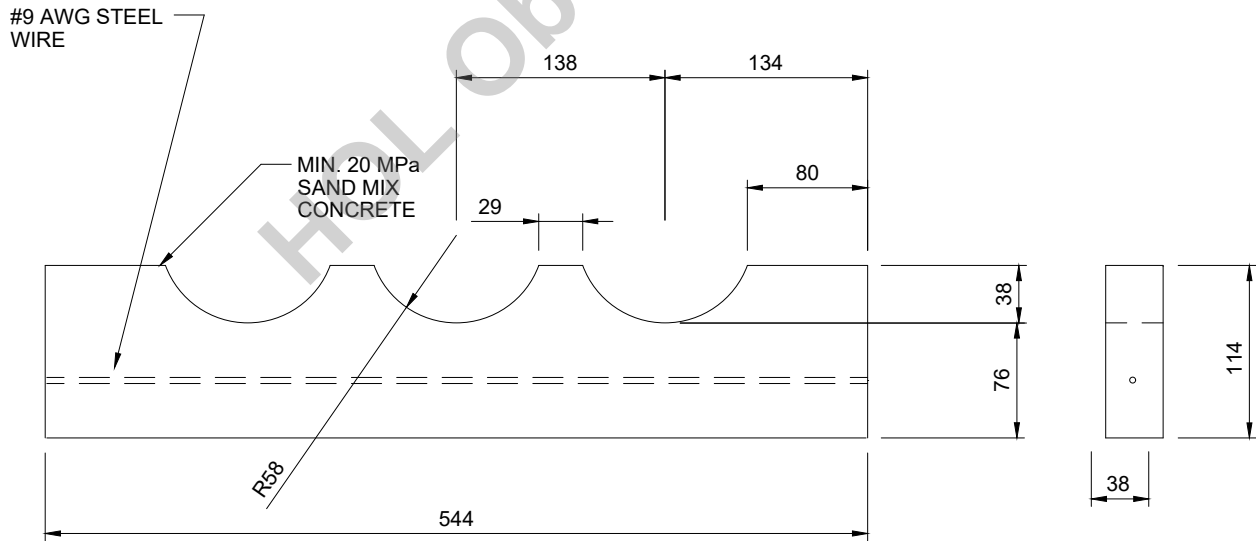

BASE SPACER

G:\4.2.3 TECH STD & MAT\01 STDS\01 HOL\U-UNDERGROUND\DUCTS.TRENCHING\UDS0007 R3 DUCT CONCRETE SPACERS.DWG

REVISIONS				PREP	CHKD	APPD	 www.hydroottawa.com	TITLE
REV: 1	DATE: 2007-08-27	CP	CP	CSM				ENGINEERING SPECIFICATION
CHANGE: NOTES LAYOUT CHANGED								DUCT CONCRETE SPACERS
REV: 2	DATE: 2010-05-18	FB	RW	CSM	PREP: G. MOLNAR			CONSTRUCTION DETAIL
CHANGE: TITLE CHANGE								
REV: 3	DATE: 2020-05-28	EV	MW	RH	APPD: C. MALONE P.Eng			
CHANGE: MADE OBSOLETE								
							NO:	
							UDS0007	
							1 OF 1	
							REV: 3	