



NOTES:

- A. DUCT SADDLE RADIUS IS CRITICAL.
- B. SPACERS TO BE USED WITH 100mm. TYPE EBIPVC DUCTING C.S.A. SPECIFICATION C22.3 No. 211.1 SUPPLIED BY CONTRACTOR.
- C. REFER TO DWG. UDSC001 FOR SPACER ARRANGEMENT IN DUCT BANK.
- D. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED

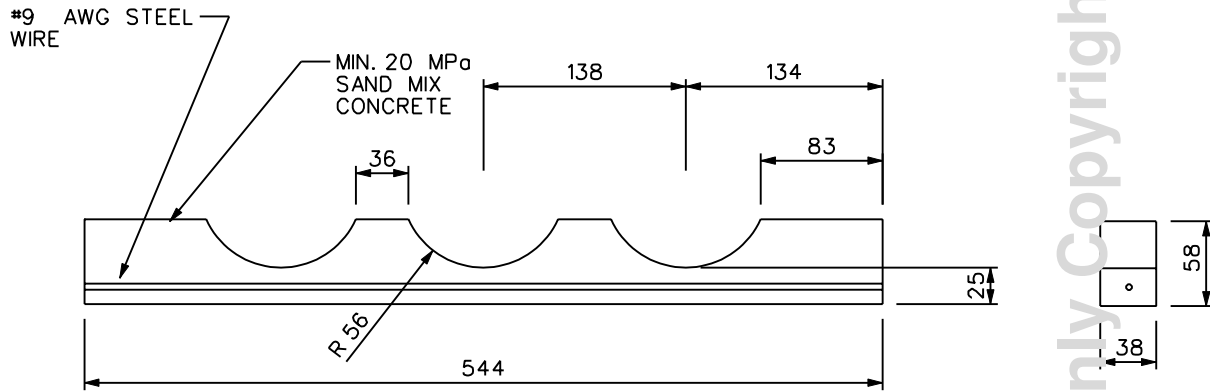

INTERMEDIATE SPACER

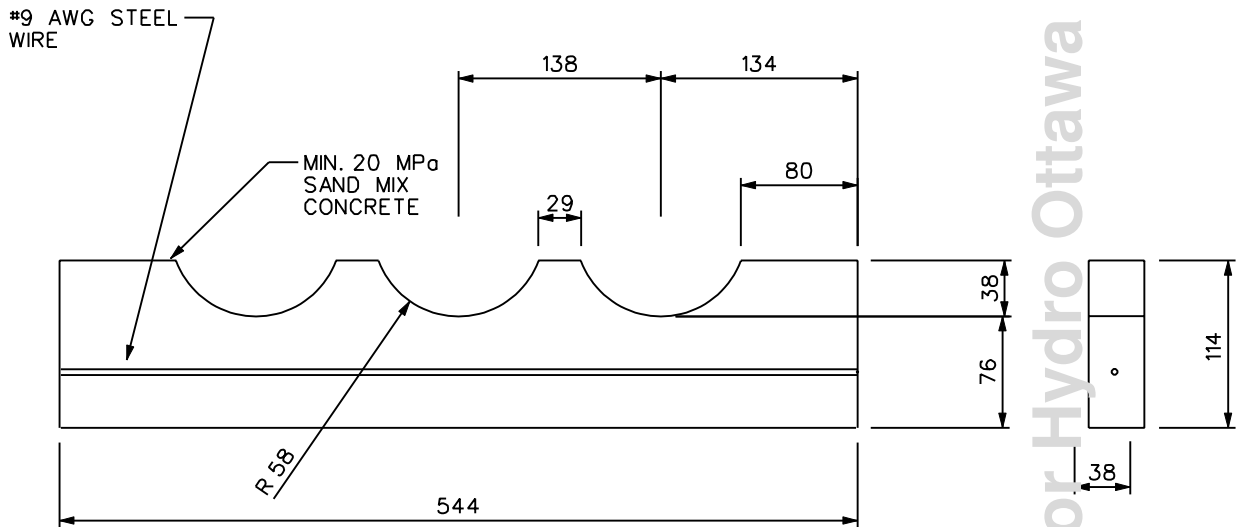

BASE SPACER

For Hydro Ottawa Use Only Copyright 2010

5/20/2010 8:14:40 AM

REVISIONS				PREP	CHKD	APPD	TITLE	
REV: 1	DATE: 2007-08-27	CP	CP	CSM	HydroOttawa WWW.HYDRO-OTTAWA.COM PREP: G. MOLNAR CHKD: C. PROULX APPD: C. MALONE P.Eng. DATE: 2002-04-04 SCALE: 1:5 @ ANSIA			
CHANGE: NOTES LAYOUT CHANGED								
REV: 2	DATE: 2010-05-18	FB	RW	CSM				
CHANGE: TITLE CHANGE					ENGINEERING SPECIFICATION DUCT CONCRETE SPACERS CONSTRUCTION DETAIL			
REV: 1	DATE: YYYY-MM-DD				NO: UDS0007			
CHANGE:					1 OF 1 REV: 2			