


**NOTES:**

- A. SPLICE PITS (MINIMUM DIMENSION OF 1200mm x 1200mm SHALL BE COMPLETELY BACKFILLED WITH CLEAN SAND.
- B. ALL MEASUREMENTS IN MILLIMETERS UNLESS OTHERWISE NOTED.
- C. TRENCH AND ALL BACKFILL MATERIAL MUST BE APPROVED BY HYDRO OTTAWA INSPECTOR PRIOR TO BACKFILLING. FOR ACCEPTABLE BACKFILL MATERIAL, SEE HYDRO OTTAWA SPECIFICATION GCS0001 AND GCS0005.
- D. SERVICE LAYOUT ON THE RIGHT SIDE OF THE PROPERTY LINE IS MIRROR IMAGE OF THE ABOVE.
- E. DUCT TO BE JOINED AT THE PROPERTY LINE TO PROVIDE A CONTINUOUS CONDUIT FROM THE SUPPLY POINT TO 1200mm FROM THE METER BASE.

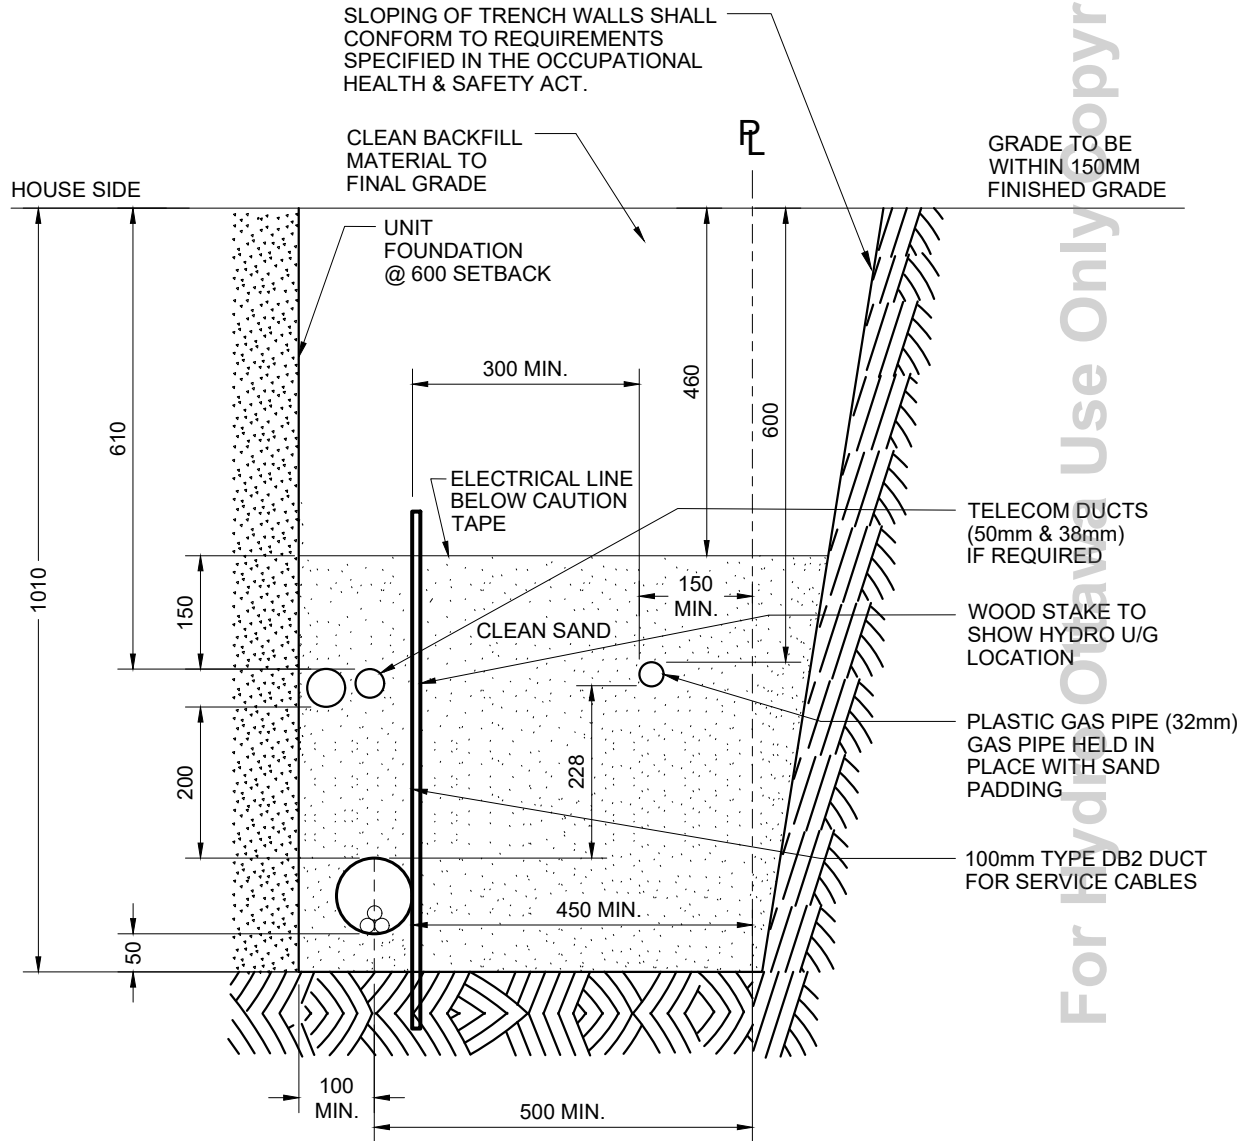

<b>REVISIONS</b> REV: 4    DATE: 2008-10-03 CHANGE: UPDATED NOTE 'F' REF: UDS0014			PREP: GM CHKD: CP APPD: CSM	 www.HYDROOTTAWA.COM	<b>TITLE</b> ENGINEERING SPECIFICATION TRENCH JOINT UTILITY 4 PARTY SERVICE RESIDENTIAL CONSTRUCTION DETAIL	NO:	1 OF 1 REV: 6
REV: 5    DATE: 2010-05-27 CHANGE: TITLE CHANGE			PREP: FB CHKD: RW APPD: CSM				
REV: 6    DATE: 2020-05-27 CHANGE: MODIFIED CLEARANCES & DEPTH, ADDED TELECOM & GAS SIZE, MODIFIED NOTES			PREP: EV CHKD: AK APPD: MW				
				PREP: G. MOLNAR CHKD: C. MORAN APPD: C. MALONE    P. Eng DATE: 2002-09-30 SCALE: N.T.S. @ ANSI A			