



SLOPING OF TRENCH WALLS SHALL CONFORM TO REQUIREMENTS SPECIFIED IN THE OCCUPATIONAL HEALTH & SAFETY ACT.

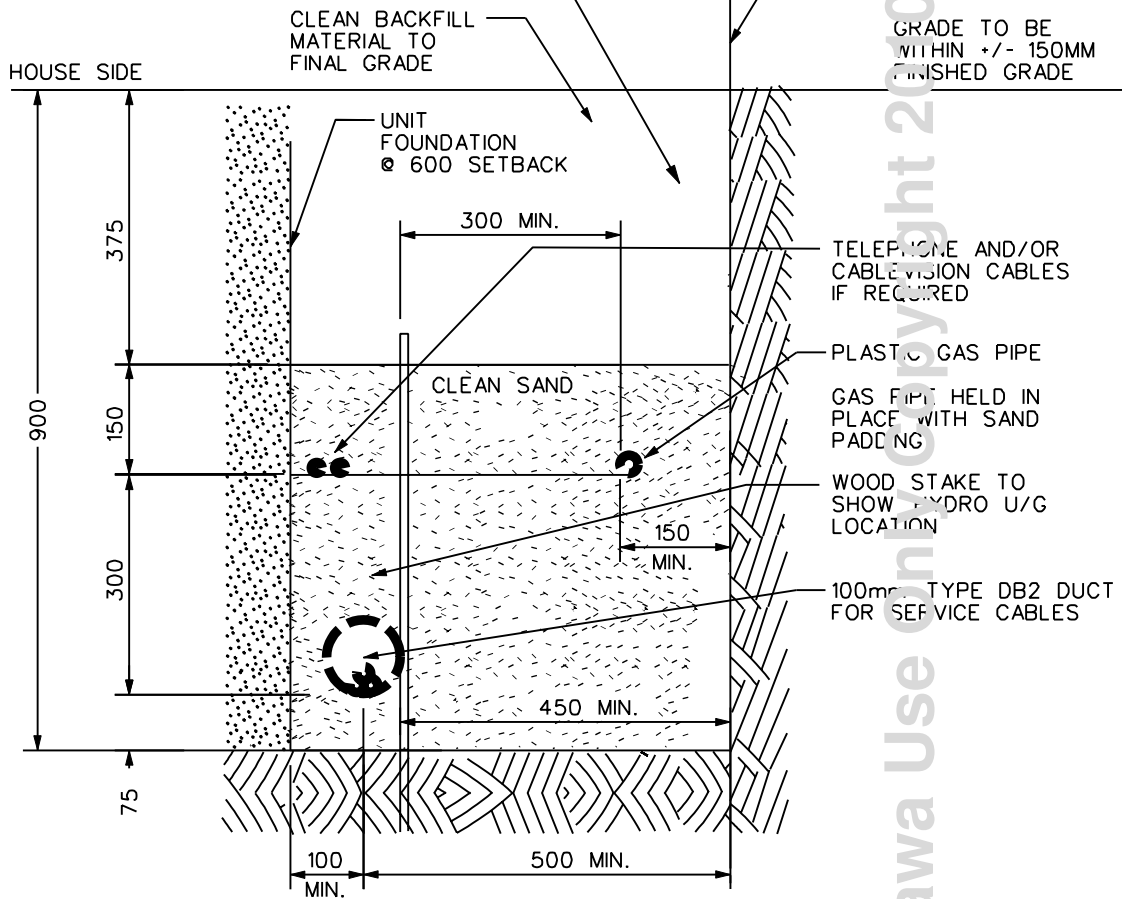

### SECTION VIEW TRENCH

#### NOTES

- A. SPLICE PITS (MINIMUM DIMENSION OF 1200mm x 1200mm SHALL BE COMPLETELY BACKFILLED WITH CLEAN SAND.
- B. ALL MEASUREMENTS IN MILLIMETERS UNLESS OTHERWISE NOTED.
- C. TRENCH AND BACKFILL MATERIAL TO BE APPROVED BY HYDRO OTTAWA PRIOR TO BACKFILLING.
- D. SERVICE LAYOUT ON THE RIGHT SIDE OF THE PROPERTY LINE IS MIRROR IMAGE OF THE ABOVE.
- E. DUCT TO BE JOINED AT THE PROPERTY LINE TO PROVIDE A CONTINUOUS CONDUIT FROM THE SUPPLY POINT TO 1000mm FROM THE METER BASE.
- F. ALL BACKFILL MATERIAL MUST BE APPROVED BY HYDRO OTTAWA INSPECTOR: FOR ACCEPTABLE BACKFILL MATERIAL, SEE HYDRO OTTAWA SPECIFICATION DOCUMENT GCS0001 APPENDIX "A".

REVISIONS	PREP	CHKD	APPD	TITLE
REV: 3 DATE: 2007-05-02 CHANGE: NOTE RE FINISHED GR NOTES LAYOUT CHANGED	CP	CP	CSM	<b>ENGINEERING SPECIFICATION</b> <b>TRENCH JOINT UTILITY 4 PARTY SERVICE RESIDENTIAL</b> <b>CONSTRUCTION DETAIL</b>
REV: 4 DATE: 2008-10-03 CHANGE: UPDATED NOTE 'F' REF: UDS0014	GM	CP	CSM	
REV: 5 DATE: 2010-05-27 CHANGE: TITLE CHANGE	FB	RW	CSM	
 www.HYDRO-OTTAWA.COM				PREP: G. MOLNAR CHKD: C. MORAN APPD: C. MALONE P. Eng DATE: 2002-09-30 SCALE: N.T.S. @ ANSIA
				NO: <b>UDS0016</b>
				1 OF 1 REV: <b>5</b>

6/7/2010 8:06:29 AM