



For Hydro Ottawa Use Only Copyright 2020

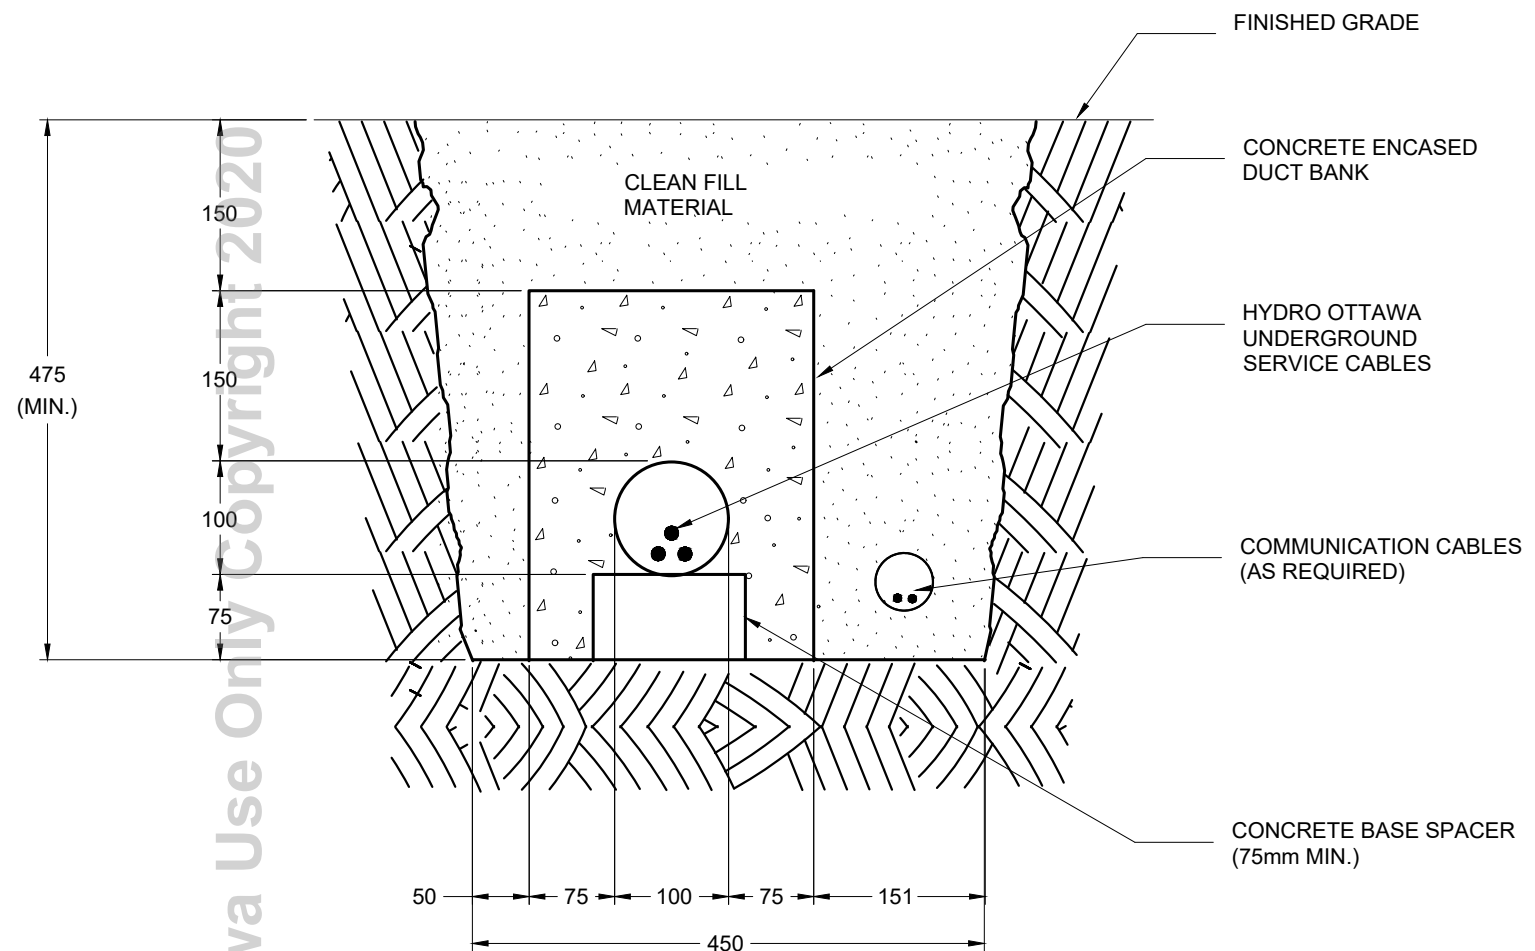

SECTION 'A-A'

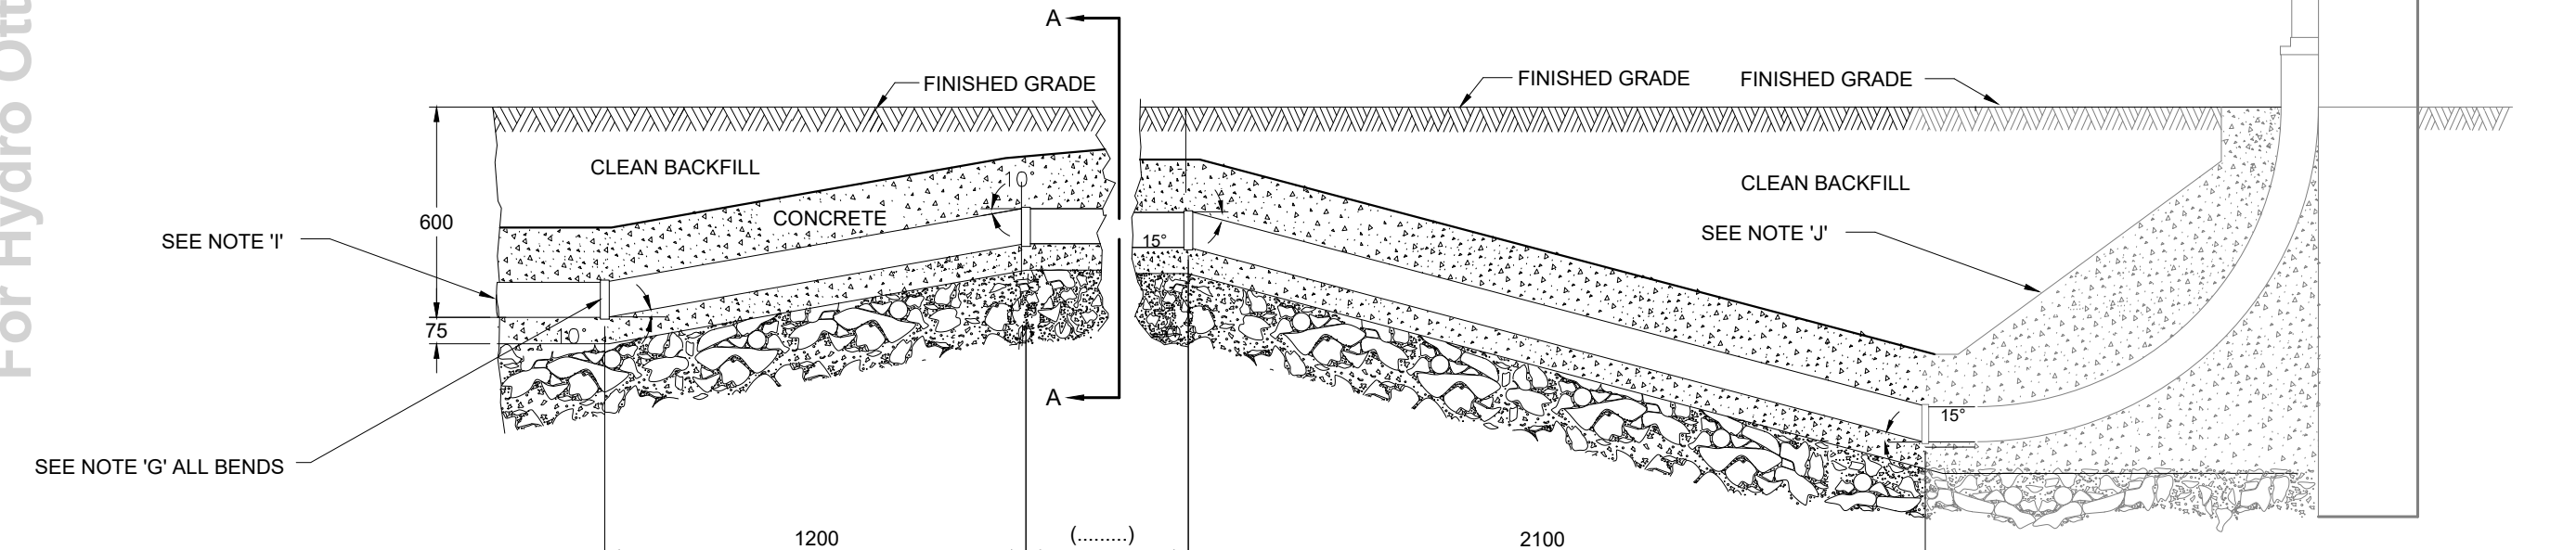

NOTES:

- A. FOR USE ONLY WHEN DEPTH AS PER UDS0003 CANNOT BE ACHIEVED DUE TO SUB-SURFACED ROCK CONDITIONS.
- B. LOT GRADING TO BE ~ 150mm OF FINAL GRADE PRIOR TO TRENCHING.
- C. DUCT SHALL BE 100mm DB2 AS PER CSA C22.2 NO.211.1
- D. DUCT SHALL BE ENCASED IN CONCRETE @20Mpa. AS PER SECTION A-A.
- E. CONCRETE SHALL BE FORMED OVER THE FULL LENGTH OF THE TRENCH.
- F. TRENCH AND DUCT SHALL BE INSPECTED BY HYDRO OTTAWA PRIOR TO POURING OF CONCRETE.
- G. USE 5 DEGREE COUPLINGS TO ACHIEVE BENDS.
- H. ALL UNITS IN MILLIMETERS UNLESS OTHERWISE NOTED.
- I. REFER TO ECS0002 FOR TERMINATION AT METER BASE.
- J. REFER TO UDS0023 FOR POLE LATERAL.

REVISIONS		PREP	CHKD	APPD
REV: 3	DATE: 2008-04-08 CHANGE: NOTES 'I' AND 'J' ADDED POLE LATERAL GREYED OUT	GM	KM	CSM
REV: 4	DATE: 2010-05-27 CHANGE: TITLE CHANGE	FB	RW	CSM
REV: 5	DATE: 2020-03-17 CHANGE: RE-AFFIRMED	EV	AK	MW

HydroOttawa
WWW.HYDROOTTAWA.COM

PREP: G. MOLNAR
CHKD: K. McROBERTS
APPD: C. MALONE P. Eng
DATE: 2005-11-22
SCALE: N.T.S. @ ANSI B

TITLE: ENGINEERING SPECIFICATION
TRENCH JOINT UTILITY
3 PARTY SERVICE
RESIDENTIAL IN ROCK
CONSTRUCTION DETAIL

NO: UDS0021

1 OF 1 REV: 5

LAST SAVED: 2020-03-17 12:23 PM