

NOTES:

- A. ALL UNITS IN MILLIMETERS UNLESS OTHERWISE NOTED.
- B. ALL BACKFILL MATERIAL MUST BE APPROVED BY HYDRO OTTAWA INSPECTOR. FOR ACCEPTABLE BACKFILL MATERIAL, SEE HYDRO OTTAWA SPECIFICATION DOCUMENT GCS0005.
- C. REINFORCING RODS FULL LENGTH OF CONCRETE ENCASED DUCTS. OVERLAP JOINTS BY 150mm ON BASE SPACERS AND TIE BOTH ENDS.
- D. REFER TO UDS0001 FOR DUCT CONCRETE CROSS SECTIONS DETAILS.

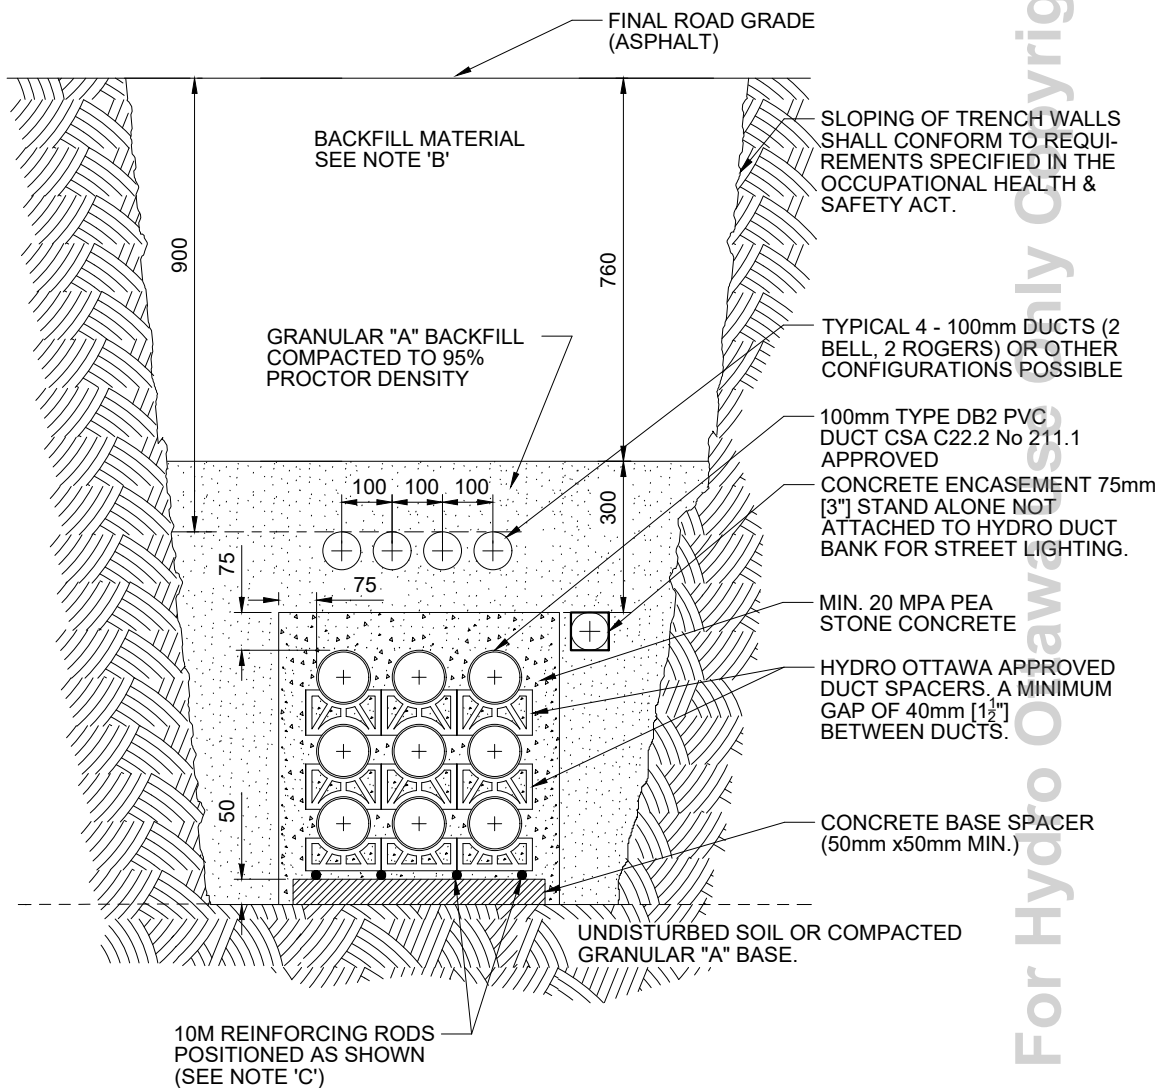



FIG 1. TYPICAL CONCRETE DUCT BANK SECTION VIEW

REVISIONS		PREP	CHKD	APPD	TITLE					
REV: 1	DATE: 2020-02-10	EV	AK	BDH		ENGINEERING SPECIFICATION THREE PARTY RESIDENTIAL ROAD CROSSING CONCRETE DUCT BANK CONSTRUCTION DETAIL				
CHANGE:	RE-AFFIRMED									
REV:	DATE:				NO:					
CHANGE:										
REV:	DATE:									
CHANGE:										
 www.HYDROOTTAWA.COM PREP: G. MOLNAR CHKD: K. McROBERTS APPD: C. MALONE P.Eng DATE: 2007-07-03 SCALE: N.T.S. @ ANSI A					1 OF 1					
						UDS0025				
						1				
						REV: 1				

For Hydro Ottawa Use Only Copyright 2020