


G:\4.2.3 TECH STD & MAT\01_STDS\01_HOLLU-UNDERGROUND-DUCTS,TRENCHING\UDS0046 R1 THREE PARTY RESIDENTIAL ROAD CROSSING CONCRETE DUCT BANK.DWG

NOTES:

- A. ALL UNITS IN MILLIMETERS UNLESS OTHERWISE NOTED.
- B. ALL BACKFILL MATERIAL UP TO 150mm ABOVE THE CONCRETE DUCT BANK MUST BE APPROVED BY HYDRO OTTAWA INSPECTOR. FOR ACCEPTABLE BACKFILL MATERIAL ABOVE 150mm OF THE CONCRETE DUCT BANK MUST BE APPROVED BY TELECOMMUNICATION AND GAS UTILITIES.
- C. REINFORCING RODS FULL LENGTH OF CONCRETE ENCASED DUCTS. OVERLAP JOINTS BY 150mm ON BASE SPACERS AND TIE BOTH ENDS.
- D. REFER TO UDS0001 FOR DUCT CONCRETE CROSS SECTIONS DETAILS.

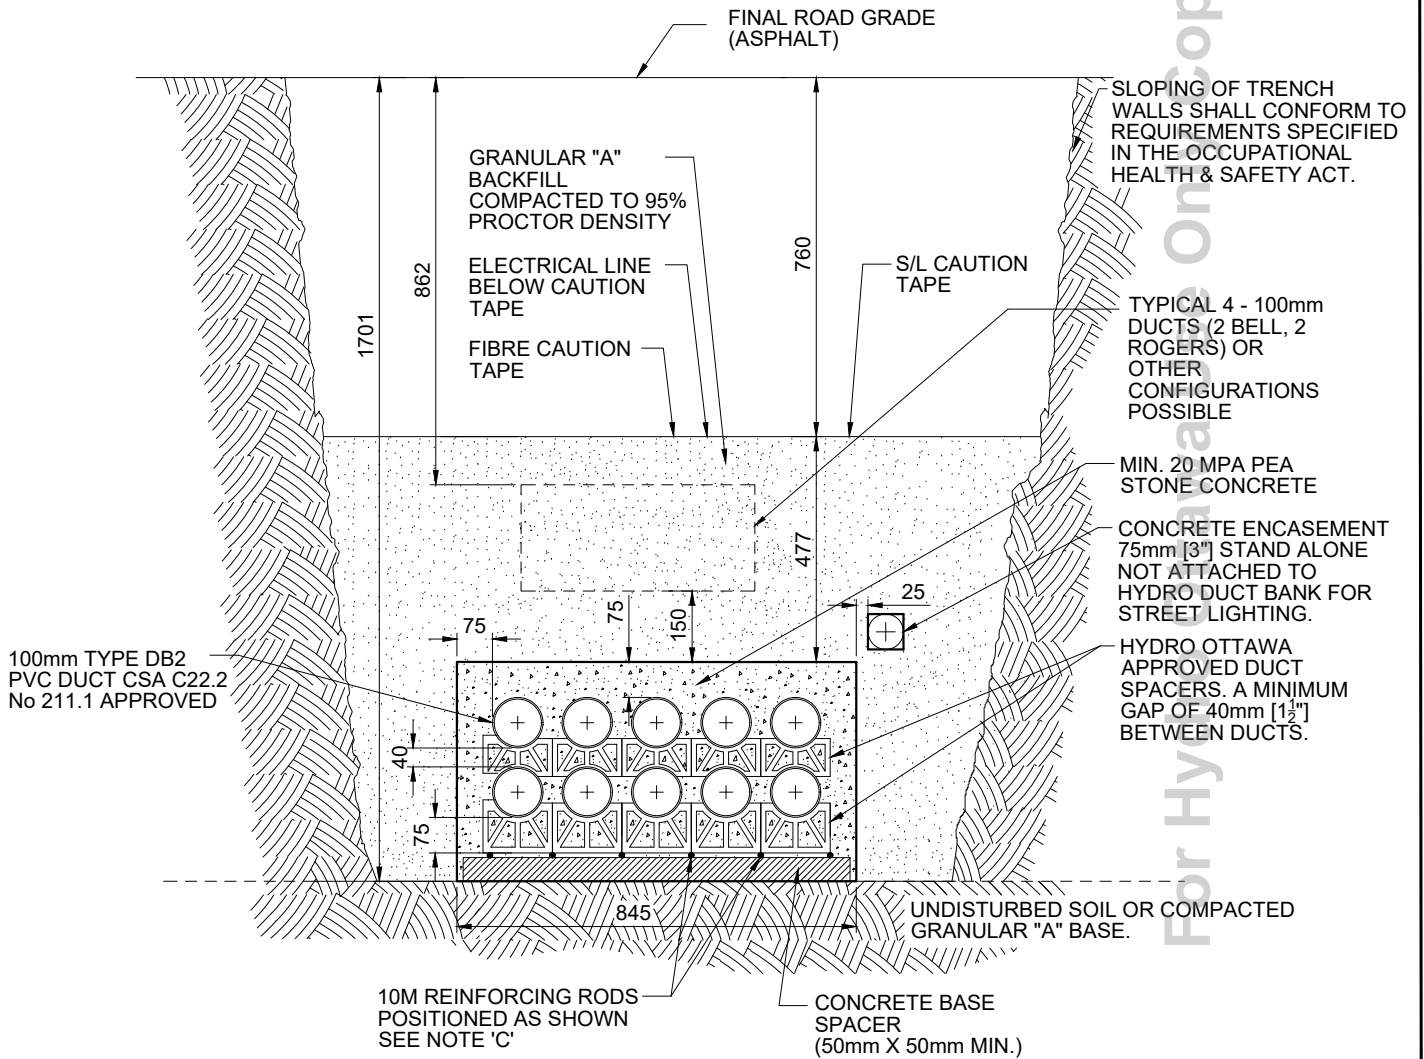

REVISIONS		PREP	CHKD	APPD
REV: 1	DATE: 2022-11-03	LS	GJ, AA, KR	MW
CHANGE: ADDED CAUTION TAPE				
REV:	DATE:			
CHANGE:				
REV:	DATE:			
CHANGE:				

HydroOttawa
 WWW.HYDROOTTAWA.COM

PREP: E. VEH
CHKD: A. KHAIRI / M. WYNDHAM
APPD: B. HAZLETT P. Eng
DATE: 2020-02-05
SCALE: N.T.S. @ ANSI A

TITLE	ENGINEERING SPECIFICATION TRENCH JOINT UTILITY 3 PARTY MAIN RESIDENTIAL ROAD CROSSING CONSTRUCTION DETAIL						
NO:	UDS0046						
	<table border="1" style="display: inline-table;"> <tr> <td style="text-align: center;">1</td> <td>REV:</td> </tr> <tr> <td style="text-align: center;">OF</td> <td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">1</td> </tr> </table>	1	REV:	OF		1	1
1	REV:						
OF							
1	1						