


For Hydro Ottawa Use Only Copyright 2010

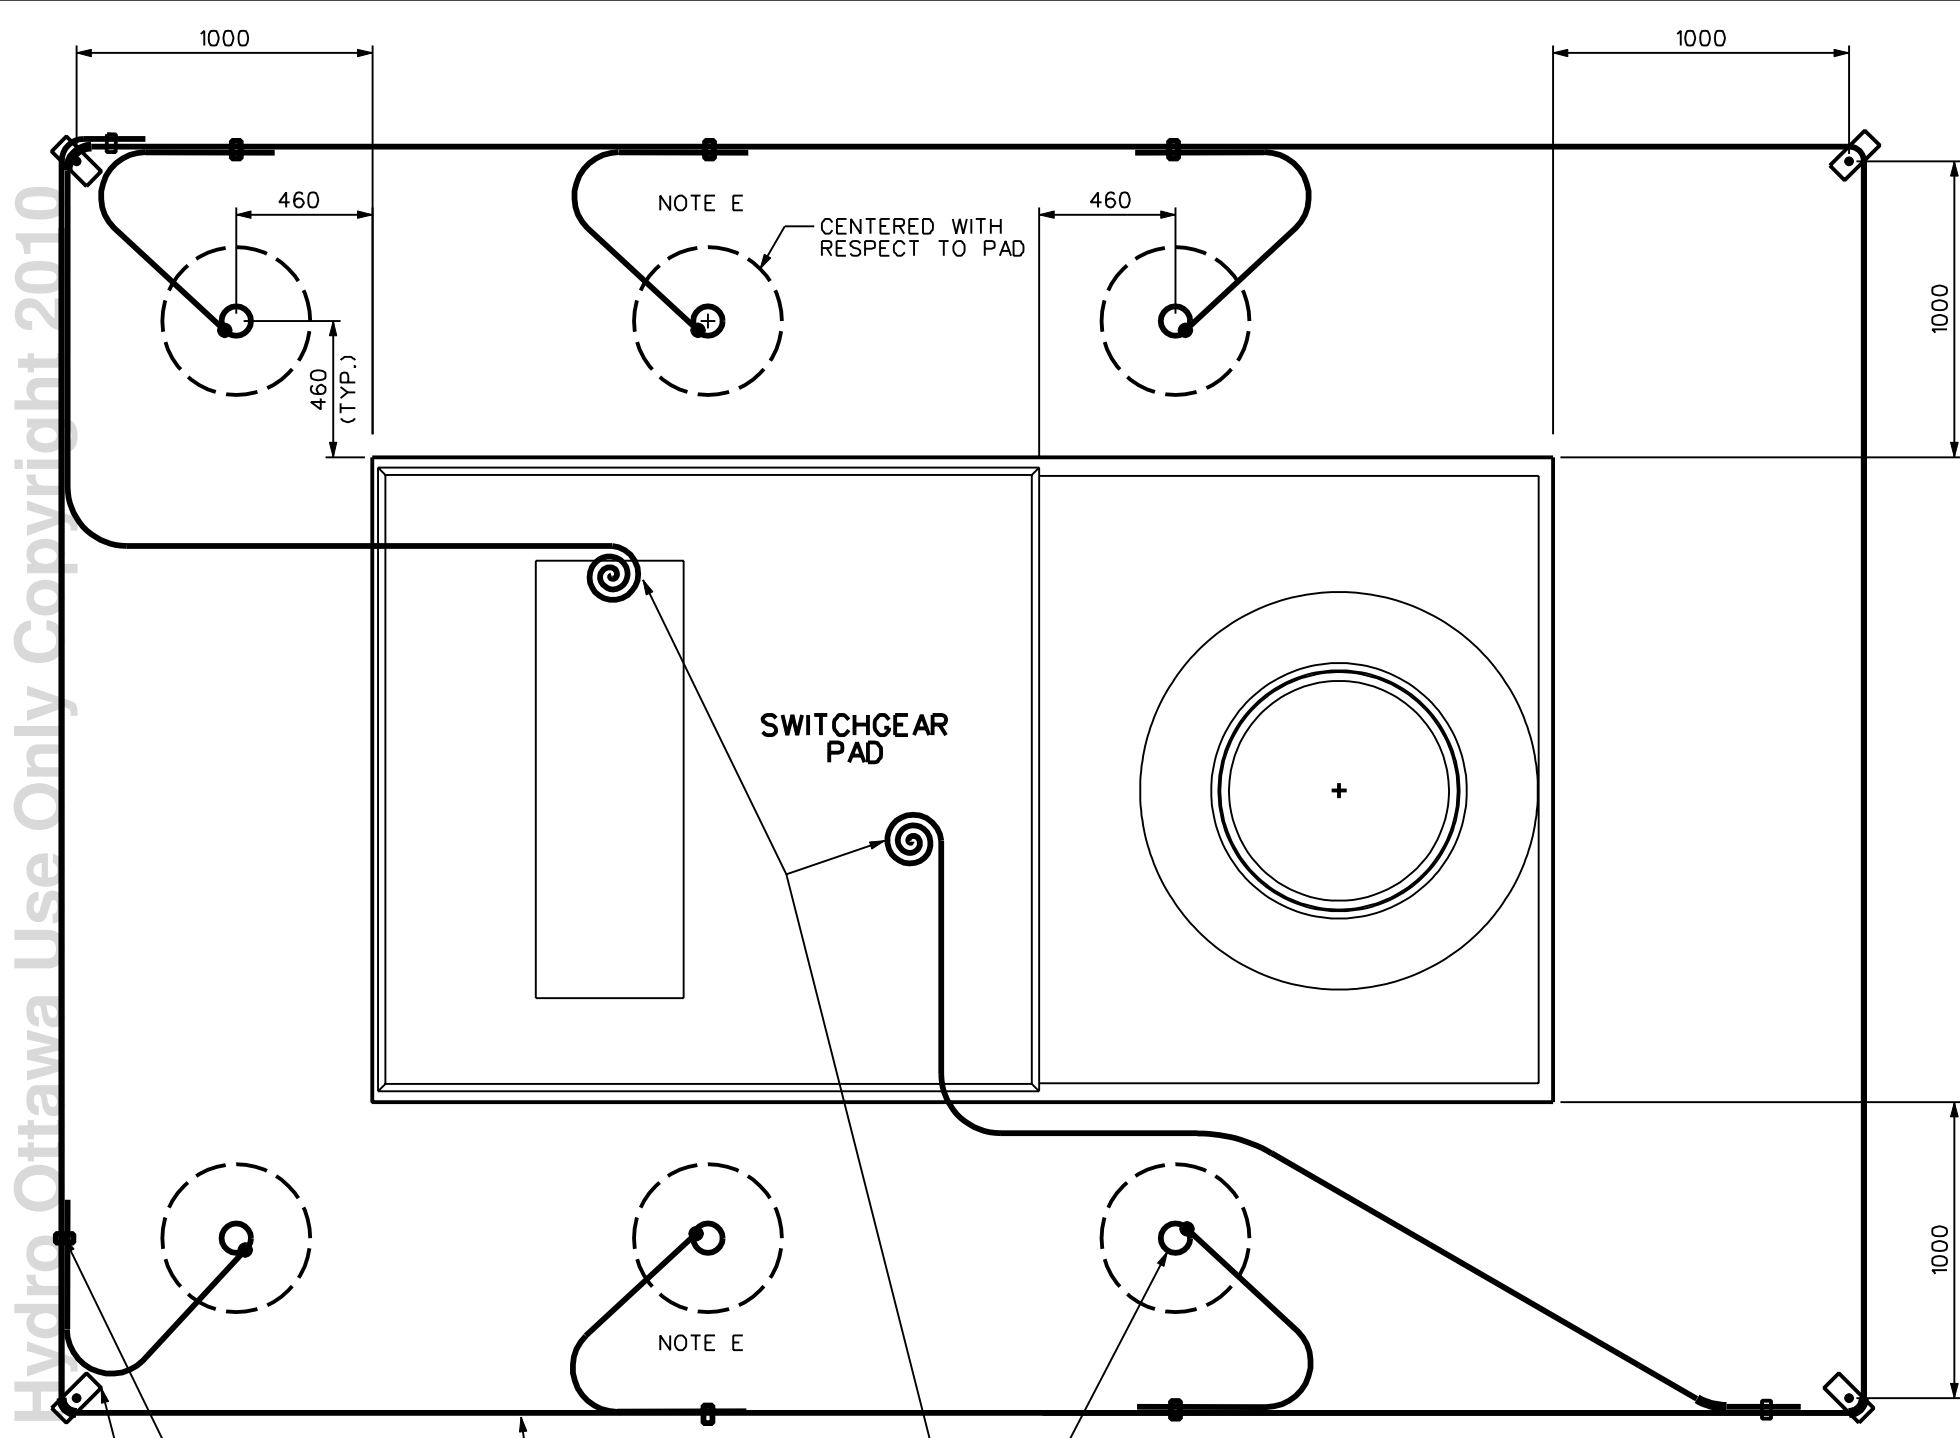

GROUND LOOP PLAN

NOTES:

- A. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
- B. THE GROUNDING SHALL BE DONE IN ACCORDANCE WITH THE ONTARIO ELECTRICAL SAFETY CODE AND INSPECTED BY HYDRO OTTAWA PRIOR TO BACKFILLING. WHEN THE ELECTRICAL EQUIPMENT IS TO SUPPLY A CUSTOMER ON PRIVATE PROPERTY, ESA INSPECTION IS REQUIRED PRIOR TO BACKFILLING.
- C. ADDITIONAL GROUNDING RODS AND/OR PLATES SHALL BE ADDED TO OBTAIN A SATISFACTORY GROUND RESISTANCE OF ≤ 25 OHMS.(ISOLATED) OR ≤ 6 OHMS CONNECTED TO SYSTEM NEUTRAL
- D. ALL GROUNDING EQUIPMENT TO BE CSA APPROVED.
- E. PROTECTIVE BOLLARDS REQUIRED AS STATED IN DESIGN.
- F. EXCAVATION TO BE BACKFILLED AND COMPACTED TO 600mm WITH THE BALANCE OF THE EXCAVATION TO REMAIN OPEN FOR GROUNDING INSTALLATION BY CONTRACTOR. UNTIL INSPECTION COMPLETE.
- G. METAL BOUNDARY FENCE OR OTHER METAL STRUCTURES WITHIN 2.4m OR LESS OF THE PADMOUNTED EQUIPMENT SHALL BE BOUNDED TO THE EQUIPMENT GROUND LOOP IN ACCORDANCE TO THE OESC AND BULLETIN 36-10-11.

BURNDY COMPRESSION GROUND CONNECTOR

19mm x 3000mm GROUND ROD (GALVANIZED OR COPPER CLAD) COMPLETE WITH GROUND ROD CLAMP STOCK NO. 476409 (MIN. 4 REQ'D.)

MINIMUM 3.0m [10'] TAILS INSIDE BASE. WIRE TO PENETRATE MANHOLE 300mm BELOW GRADE (USE PREDRILLED HOLES WHERE PROVIDED)

PROTECTIVE BOLLARD COMPLETE WITH GROUND TAIL AS PER UFS0001

CONTINUOUS RUN OF 2/0 BARE COPPER AT A DEPTH OF 300mm BELOW FINAL GRADE

REVISIONS			PREP	CHKD	APPD
REV: 3	DATE: 2008-05-13	CHANGE: LOCATION OF PROTECTIVE POSTS NOTE C REFERENCE TO UFS0001	GM	CP	CSM
REV: 4	DATE: 2009-01-12	CHANGE: NOTE B REVISED RE ESA INSPECTION	GM	CP	CSM
REV: 5	DATE: 2010-05-27	CHANGE: TITLE CHANGE	FB	RW	CSM

HydroOttawa
WWW.HYDRO-OTTAWA.COM

PREP: G. MOLNAR
CHKD: C. PROULX
APPD: C. MALONE P.Eng.
DATE: 2003-02-26
SCALE: 1:25 @ ANSIB

TITLE		ENGINEERING SPECIFICATION GROUNDING PRECAST 2 WAY SWITCHING MANHOLE 612 GROUNDING DETAIL	
NO:	UGS0005	REV:	1 OF 1
			5